
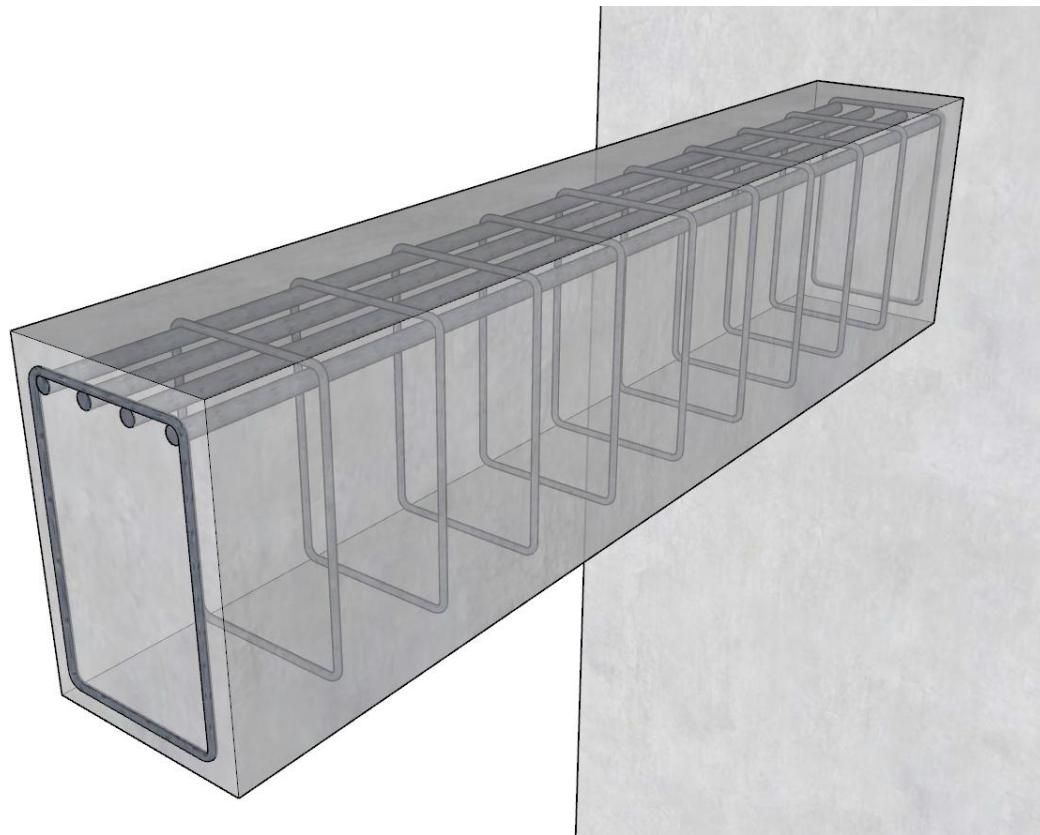


Reinforced Concrete Cantilever Beam Analysis and Design (CSA A23.3-14)

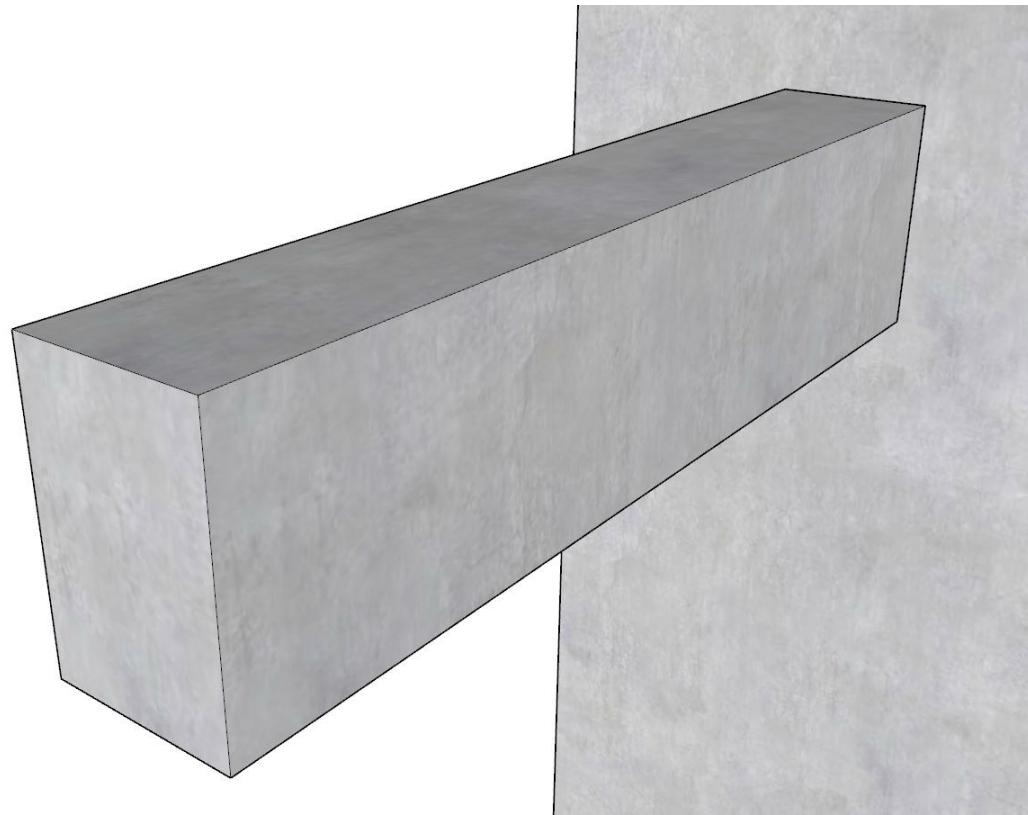

Reinforced Concrete Cantilever Beam Analysis and Design (CSA A23.3-14)

Cantilever beams consist of one span with fixed support at one end and the other end is free. There are numerous typical and practical applications of cantilever beams in buildings, bridges, industrial and special structures.

This example will demonstrate the analysis and design of the rectangular reinforced concrete cantilever beam shown below. Steps of the structural analysis, flexural design, shear design, and deflection checks will be presented. The results of hand calculations are then compared with the reference results and numerical analysis results obtained from the [spBeam](#) engineering software program by [StructurePoint](#).

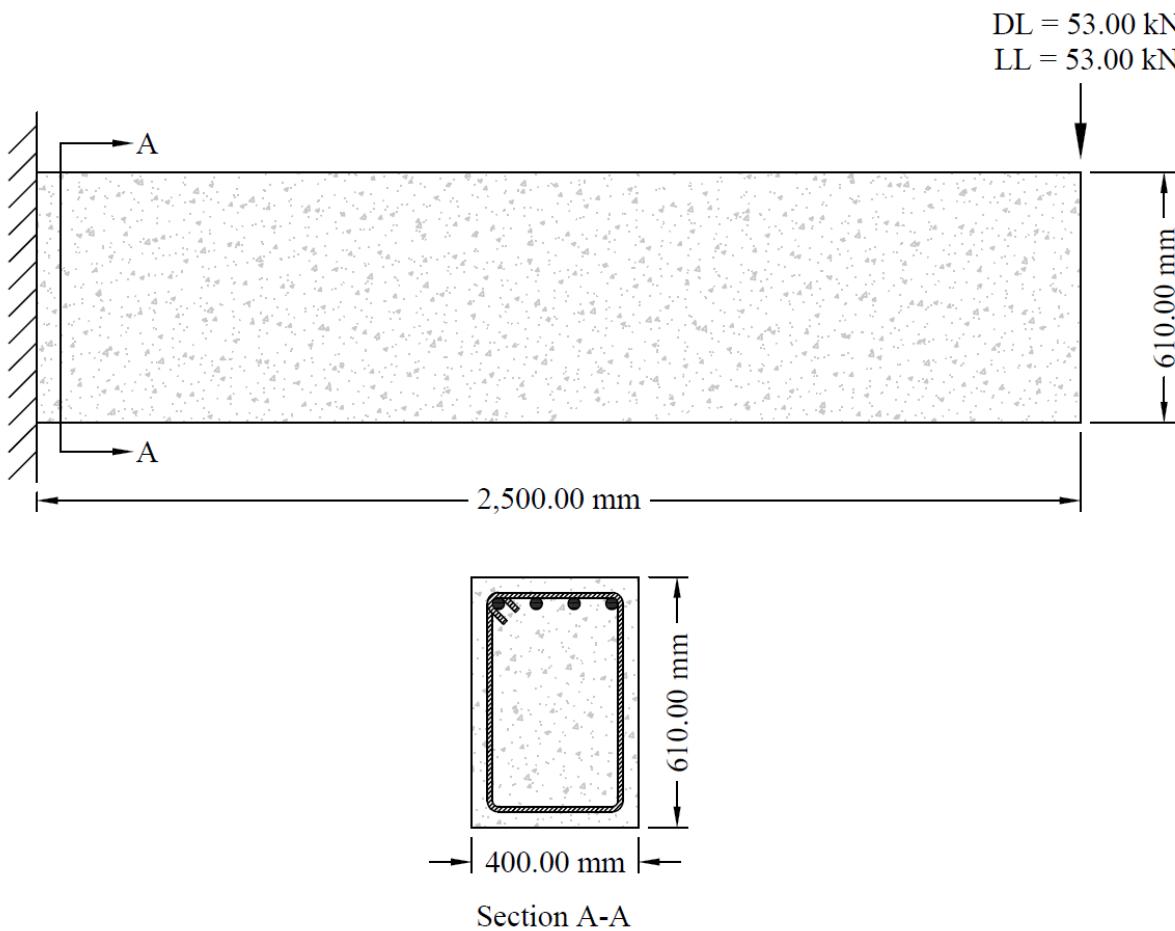


Figure 1 – Rectangular Reinforced Concrete Cantilever Beam

Contents

1. Preliminary Member Sizing	2
2. Load and Load Combination.....	2
3. Structural Analysis	3
4. Flexural Design	4
4.1. Required and Provided Reinforcement	4
4.2. Minimum Requirements and Detailing Provisions	6
4.2.1. Spacing of Longitudinal Reinforcement.....	6
4.2.2. Skin Reinforcement.....	6
4.2.3. Flexural Cracking Control.....	6
5. Shear Design	7
6. Deflection Control (Serviceability Requirements).....	9
6.1. Immediate (Instantaneous) Deflections.....	9
6.2. Time-Dependent (Long-Term) Deflections (Δ_h).....	13
7. Cantilever Beam Analysis and Design – spBeam Software	14
8. Analysis and Design Results Comparison and Conclusions	33

Code

Design of Concrete Structures (CSA A23.3-14) and Explanatory Notes on CSA Group standard A23.3-14 “Design of Concrete Structures”

References

- [spBeam Engineering Software Program Manual v10.00, STRUCTUREPOINT](#), 2024
- Contact Support@StructurePoint.org to obtain supplementary materials ([spBeam](#) model: DE-Cantilever-Beam-CSA-14.slbx)

Design Data

$f_c' = 28$ MPa normal weight concrete ($w_c = 24.00$ kN/m³)

$f_y = 400$ MPa

Dead Loads, $DL = 53.00$ kN (self-weight is negligible) applied at the free end

Live Loads, $LL = 53.00$ kN applied at the free end

Beam Span Length, $L = 2.50$ m

Use No. 30M bars for longitudinal reinforcement ($A_s = 700.00$ mm², $d_b = 29.90$ mm)

Use No. 10M bars for stirrups ($A_s = 100.00$ mm², $d_b = 11.30$ mm)

Clear cover = 30.00 mm

[CSA A23.3-14 \(Table 17\)](#)

a_{max} = maximum aggregate size = 20.00 mm

Solution

1. Preliminary Member Sizing

Check the minimum beam depth requirement of CSA A23.3-14 (9.8.2.1) to waive deflection computations.

Using the minimum depth for non-prestressed beams in Table 9.2.

$$h_{\min} = \frac{l_n}{8} = \frac{2,500}{8} = 312.50 \text{ mm (For cantilever beams)}$$

CSA A23.3-14 (Table 9.2)

Therefore, since $h_{\min} = 312.50 \text{ mm} < h = 610.00 \text{ mm}$ the preliminary beam depth satisfies the minimum depth requirement, and the beam deflection computations are not required.

In absence of initial dimensions, the width of the rectangular section (b) may be chosen in the following range recommended by the reference:

$$\left(\frac{1}{2} \times h = 305.00 \text{ mm} \right) \leq b = 400.00 \text{ mm} \leq \left(\frac{2}{3} \times h = 406.67 \text{ mm} \right) \quad o.k.$$

2. Load and Load Combination

For the factored Load

$$P_f = 1.25 \times DL + 1.50 \times LL$$

CSA A23.3-14 (Annex C, Table C.1a)

$$P_f = 1.25 \times 53.00 + 1.50 \times 53.00 = 145.75 \text{ kN}$$

Note that the beam self-weight is neglected for comparison purposes. The effect of self-weight will be investigated later in this document.

3. Structural Analysis

Cantilever beams can be analyzed by calculating shear and moment diagrams or using Design Aid tables as shown below:

Shear and Moment Diagrams:

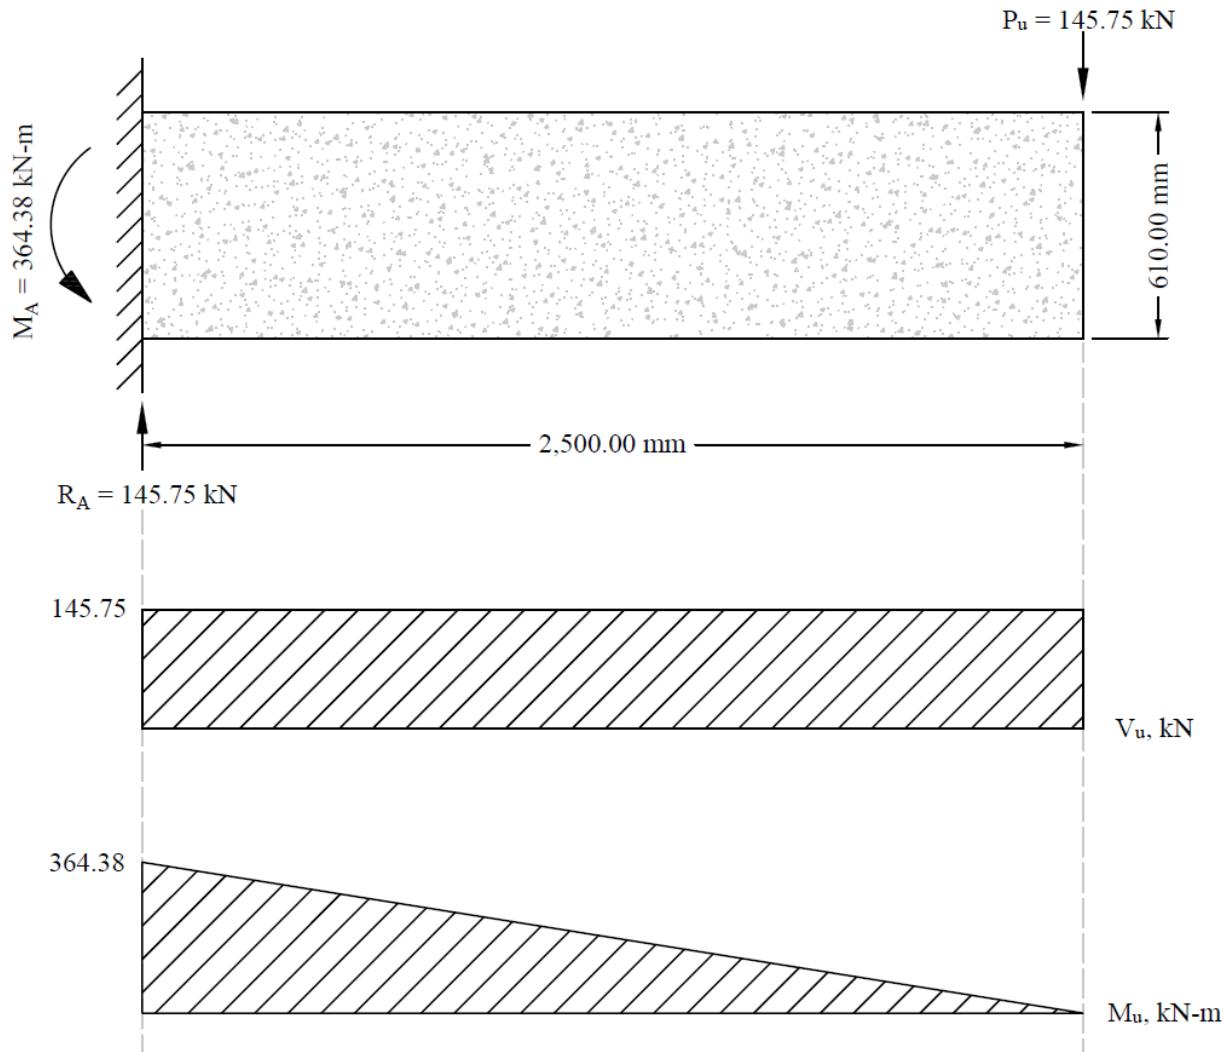


Figure 2 – Shear and Bending Moment Diagrams

Using Design Aid Tables:

$$V_f = R_A = P_f = 145.75 \text{ kN}$$

$$M_f = P_f \times L = 145.75 \times 2.50 = 364.38 \text{ kN-m}$$

CANTILEVER BEAM – CONCENTRATED LOAD AT FREE END

$$R = V = P$$

$$M_{max} (\text{at fixed end}) = P\ell$$

$$M_x = Px$$

$$\Delta_{max} (\text{at free end}) = \frac{P\ell^3}{3EI}$$

$$\Delta_x = \frac{P}{6EI} (2\ell^3 - 3\ell^2x + x^3)$$

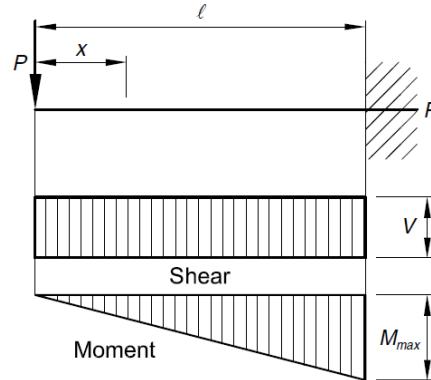


Figure 3 – Design Aid Tables (Beam Design Equations and Diagrams) – PCI Design Handbook

4. Flexural Design

4.1. Required and Provided Reinforcement

For this beam, the moment at the fixed end governs the design as shown in the [previous Figure](#).

$$M_f = 364.38 \text{ kN-m}$$

Use 30M bars with 30 mm concrete cover per [CSA A23.3-14 \(Table 17\)](#). The distance from extreme compression fiber to the centroid of longitudinal tension reinforcement, d , is calculated below:

$$d = h - \left(\text{clear cover} + d_{b,stirrups} + \frac{d_{\text{Longitudinal bar}}}{2} \right)$$

$$d = 610.00 - \left(30.00 + 11.30 + \frac{29.90}{2} \right) = 553.75 \text{ mm}$$

In this example, jd is assumed equal to $0.886 \times d$. The assumption will be verified once the area of steel is finalized.

$$jd = 0.886 \times d = 0.886 \times 553.75 = 490.62 \text{ mm}$$

$$b = 400.00 \text{ mm}$$

The required reinforcement at initial trial is calculated as follows:

$$A_s = \frac{M_f}{\phi_s \times f_y \times jd} = \frac{364.38 \times 10^6}{0.85 \times 400 \times 490.62} = 2,184.36 \text{ mm}^2$$

$$\alpha_1 = 0.85 - 0.0015 \times f'_c = 0.85 - 0.0015 \times 28 = 0.808 > 0.67$$

CSA A23.3-14 (10.1.7)

$$\beta_1 = 0.97 - 0.0025 \times f'_c = 0.97 - 0.0025 \times 28 = 0.900 > 0.67$$

CSA A23.3-14 (10.1.7)

Recalculate 'a' for the actual $A_s = 2,184.36 \text{ mm}^2$: $a = \frac{\phi_s \times A_s \times f_y}{\phi_c \times \alpha_1 \times f'_c \times b} = \frac{0.85 \times 2,184.36 \times 400}{0.65 \times 0.808 \times 28 \times 400.00} = 126.26 \text{ mm}$

$$c = \frac{a}{\beta_1} = \frac{126.26}{0.900} = 140.29 \text{ mm}$$

The tension reinforcement in flexural members shall not be assumed to reach yield unless:

$$\frac{c}{d} \leq \frac{700}{700 + f_y}$$

CSA A23.3-14 (10.5.2)

$$\frac{140.29}{553.75} = 0.253 \leq 0.636$$

$$j = \frac{d - \frac{a}{2}}{d} = \frac{d - 126.26}{d} = 0.886$$

Therefore, the assumption that tension reinforcements will yield and jd equals to $0.886 \times d$ is valid.

The minimum reinforcement shall not be less than

$$A_{s,min} = \frac{0.2 \times \sqrt{f'_c}}{f_y} \times b_t \times h = \frac{0.2 \times \sqrt{28}}{400} \times 400.00 \times 610.00 = 645.56 \text{ mm}^2$$

CSA A23.3-14 (10.5.1.2)

Where b_t is the width of the tension zone of the section considered.

$$A_{s,req} = \max \left\{ \frac{A_s}{A_{s,min}} \right\} = \max \left\{ \frac{2,184.36}{645.56} \right\} = 2,184.36 \text{ mm}^2$$

Provide 4 – 30M bars:

$$A_{s,prov} = 4 \times 700.00 = 2,800.00 \text{ mm}^2 > A_{s,req} = 2,184.36 \text{ mm}^2$$

Recalculate 'a' for the actual $A_{s,prov} = 2,800.00 \text{ mm}^2$:

$$a = \frac{\phi_s \times A_{s,prov} \times f_y}{\phi_c \times \alpha_1 \times f'_c \times b} = \frac{0.85 \times 2,800.00 \times 400}{0.65 \times 0.808 \times 28 \times 400.00} = 161.84 \text{ mm}$$

$$M_r = \phi_s \times f_y \times A_{s,prov} \times \left(d - \frac{a}{2} \right)$$

$$M_r = 0.85 \times 400 \times 2,800.00 \times \left(553.75 - \frac{161.84}{2} \right) = 450.13 \text{ kN-m} > M_f = 364.38 \text{ kN-m}$$

4.2. Minimum Requirements and Detailing Provisions

4.2.1. Spacing of Longitudinal Reinforcement

Check if $s_{provided}$ is greater than the minimum clear spacing (s_{min}):

$$s_{min} = \max \begin{cases} 1.4 \times d_b \\ 1.4 \times a_{max} \\ 30.00 \text{ mm} \end{cases}$$

CSA A23.3-14 (Annex A 6.6.5.2)

Where a_{max} is the maximum aggregate size and is given for this example ($a_{max} = 20.00 \text{ mm}$).

$$s_{min} = \max \begin{cases} 1.4 \times 29.90 \\ 1.4 \times 20.00 \\ 30.00 \end{cases} = \max \begin{cases} 41.86 \\ 28.00 \\ 30.00 \end{cases} = 41.86 \text{ mm}$$

$$s_{provided} = \frac{(b - 2 \times \text{clear cover} - 2 \times d_{stirrup} - n \times d_{bar})}{n - 1}$$

$$s_{provided} = \frac{(400.00 - 2 \times 30.00 - 2 \times 11.30 - 4 \times 29.90)}{4 - 1} = 65.93 \text{ mm} > s_{min} = 41.86 \text{ mm} \quad o.k.$$

4.2.2. Skin Reinforcement

$h = 610.00 \text{ mm} < 750.00 \text{ mm}$ skin reinforcement is not required

CSA A23.3-14 (10.6.2)

4.2.3. Flexural Cracking Control

Check the requirement for distribution of flexural reinforcement to control flexural cracking:

$$z = f_s \times (d_c \times A)^{1/3}$$

CSA A23.3-14 (10.6.1)

Use $f_s = 0.6 \times f_y = 240 \text{ MPa}$

CAC Concrete Design Handbook – 4th Edition (2.3.2)

$$A = \frac{2 \times X \times b}{n} = \frac{2 \times 56.25 \times 400.00}{4} = 11,250.00 \text{ mm}^2$$

$$X = d_c = 30.00 + 11.30 + \frac{29.90}{2} = 56.25 \text{ mm}$$

$$z = 240 \times (56.25 \times 11,250.00)^{1/3} = 20,604.86 \text{ N/mm} < 30,000.00 \text{ N/mm}$$

o.k.

5. Shear Design

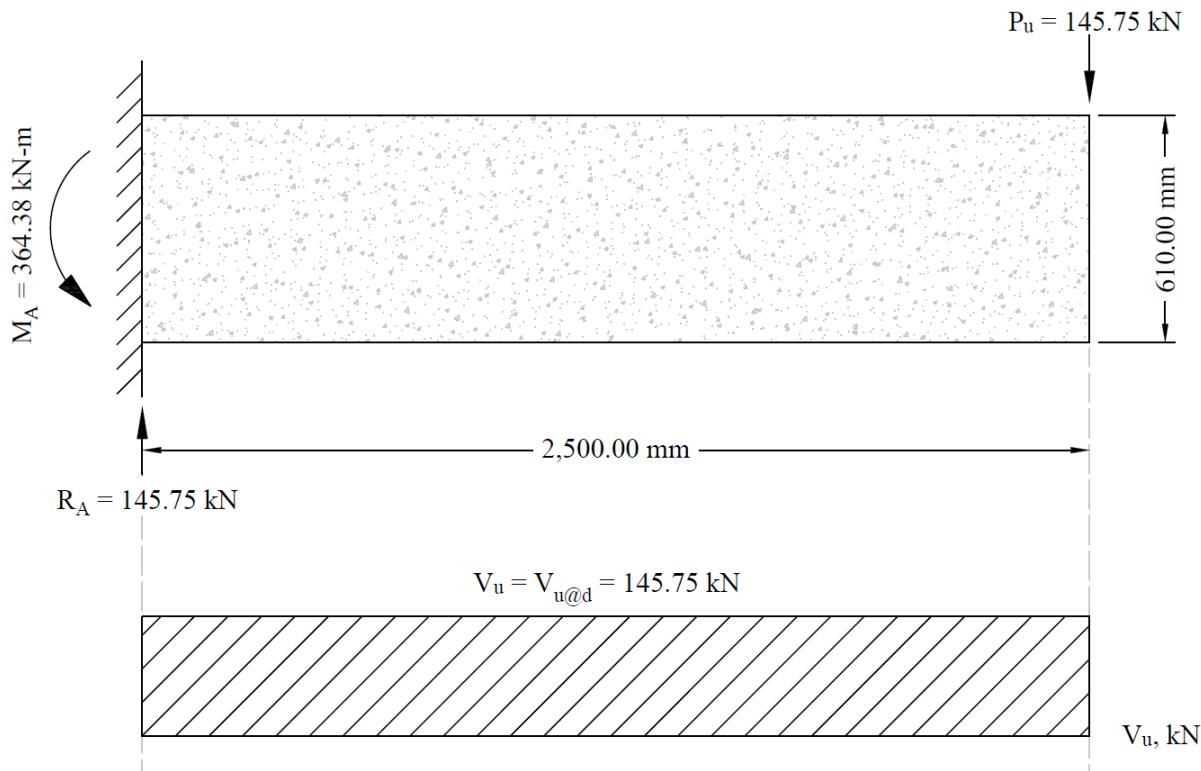


Figure 4 – Shear Diagram for Cantilever Beam

The design shear at a distance, d_v , away from the face of support,

$$d_v = \max \left\{ \frac{0.9 \times d}{0.72 \times h} \right\} = \max \left\{ \frac{0.9 \times 553.75}{0.72 \times 610.00} \right\} = \max \left\{ \frac{498.38}{439.20} \right\} = 498.38 \text{ mm} \quad \text{CSA A23.3-14 (3.2)}$$

$$V_{f@dv} = 145.75 \text{ kN}$$

The factored shear resistance shall be determined by

$$V_r = V_c + V_s + V_p = V_c \quad \text{CSA A23.3-14 (Eq. 11.4)}$$

However, V_r shall not exceed

$$V_{r,\max} = 0.25 \times \phi_c \times f'_c \times b_w \times d_v + V_p \quad \text{CSA A23.3-14 (Eq. 11.5)}$$

$$V_{r,\max} = \frac{0.25 \times 0.65 \times 28 \times 400.00 \times 498.38}{1,000} = 907.04 \text{ kN}$$

Shear strength provided by concrete

$$V_c = \phi_c \times \lambda \times \beta \times \sqrt{f'_c} \times b_w \times d_v \quad \text{CSA A23.3-14 (Eq. 11.6)}$$

$$\beta = 0.18$$

CSA A23.3-14 (11.3.6.3)

$$V_c = \frac{0.65 \times 1.00 \times 0.18 \times \sqrt{28} \times 400.00 \times 498.38}{1,000} = 123.42 \text{ kN} < V_{f@dv} = 145.75 \text{ kN} \rightarrow \text{Stirrups are required}$$

Try 10M, two-leg stirrups ($A_v = 200.00 \text{ mm}^2$).

The nominal shear strength required to be provided by shear reinforcement is

$$V_s = V_{f@dv} - V_c = 145.75 - 123.42 = 22.33 \text{ kN}$$

$$\left(\frac{A_v}{s} \right)_{req} = \frac{V_{f@dv} - V_c}{\phi \times f_{yt} \times d_v \times \cot \theta} = \frac{22.33 \times 1,000}{0.85 \times 400 \times 498.38 \times \cot 35^\circ} = 0.092 \frac{\text{mm}^2}{\text{mm}} \quad \text{CSA A23.3-14 (11.3.5.1)}$$

Where $\theta = 35^\circ$

CSA A23.3-14 (11.3.6.2)

$$\left(\frac{A_v}{s} \right)_{min} = \frac{0.06 \times \sqrt{f'_c} \times b_w}{f_{yt}} \quad \text{CSA A23.3-14 (11.2.8.2)}$$

$$\left(\frac{A_v}{s} \right)_{min} = \frac{0.06 \times \sqrt{28} \times 400.00}{400} = 0.317 \frac{\text{mm}^2}{\text{mm}} > \left(\frac{A_v}{s} \right)_{req}$$

$$\therefore \left(\frac{A_v}{s} \right)_{req} = 0.317 \frac{\text{mm}^2}{\text{mm}}$$

$$s_{req} = \frac{A_v}{\left(\frac{A_v}{s} \right)_{req}} = \frac{200.00}{0.317} = 629.94 \text{ mm}$$

Check whether the required spacing based on the shear demand meets the spacing limits for shear reinforcement per CSA A23.3-14 (11.3.8).

$$0.125 \times \lambda \times \phi_c \times f'_c \times b_w \times d_v > V_{f@dv}$$

CSA A23.3-14 (11.3.8.3)

$$0.125 \times 1.00 \times 0.65 \times 28 \times 400.00 \times 498.38 = 453.52 \text{ kN} > V_{f@dv} = 145.75 \text{ kN}$$

Therefore, maximum stirrup spacing shall be the smallest of $0.7 \times d_v$ and 600.00 mm. CSA A23.3-14 (11.3.8.1)

$$s_{max} = \min \left\{ \frac{0.7 \times d_v}{600.00 \text{ mm}} \right\} = \min \left\{ \frac{0.7 \times 498.38}{600.00} \right\} = \min \left\{ \frac{348.86}{600.00} \right\} = 348.86 \text{ mm} < s_{req}$$

\therefore use $s_{provided} = 335.00 \text{ mm} < s_{max} = 348.86 \text{ mm}$

Use 10M @ 335.00 mm stirrups (it is more practical to round the provided spacing to 50 mm, the provided spacing is kept as 335.00 mm for comparison reasons with spBeam results).

$$V_r = \frac{\phi_s \times A_v \times f_y \times d_v \times \cot \theta}{s} + V_c$$

[CSA A23.3-14 \(11.3.3 and 11.3.5.1\)](#)

$$V_r = \frac{0.85 \times 200.00 \times 400 \times 498.38 \times \cot 35^\circ}{335.00 \times 1,000} + 123.42 = 144.48 + 123.42 = 267.89 \text{ kN} > V_{f@dv} = 145.75 \text{ kN} \quad \text{o.k.}$$

Compute where V_f is equal to V_c , and the stirrups can be stopped.

[CSA A23.3-14 \(11.2.8.1\)](#)

$$x = \frac{V_f - V_c}{V_f} \times \frac{l}{2} = \frac{145.75 - 123.42}{145.75} \times \frac{2,500}{2} = 191.52 \text{ mm}$$

Use 8 – 10M @ 335.00 mm o.c., Place 1st stirrup 76.20 mm from the face of the support.

6. Deflection Control (Serviceability Requirements)

Since the preliminary beam depth met minimum depth requirement, the deflection calculations are not required. However, the calculations of immediate and time-dependent deflections are covered in detail in this section for illustration and comparison with [spBeam](#) model results for cantilever beam.

6.1. Immediate (Instantaneous) Deflections

Elastic analysis for three service load levels (D , $D + L_{sustained}$, $D + L_{Full}$) is used to obtain immediate deflections of the cantilever beam in this example. However, other procedures may be used if they result in predictions of deflection in reasonable agreement with the results of comprehensive tests.

The effective moment of inertia (I_e) is used to account for the cracking effect on the flexural stiffness of the beam. I_e for uncracked section ($M_{cr} > M_a$) is equal to I_g . When the section is cracked ($M_{cr} < M_a$), then the following equation should be used:

$$I_e = I_{cr} + (I_g - I_{cr}) \times \left(\frac{M_{cr}}{M_a} \right)^3 \leq I_g$$

[CSA A23.3-14 \(Eq. 9.1\)](#)

Where:

M_a = Maximum moment in member due to service loads at stage deflection is calculated.

The effective moment of inertia procedure described in the Code is considered sufficiently accurate to estimate deflections. The effective moment of inertia, I_e , was developed to provide a transition between the upper and lower bounds of I_g and I_{cr} as a function of the ratio M_{cr}/M_a .

Unless deflections are determined by a more comprehensive analysis, immediate deflection shall be computed using elastic deflection equations using the effective moment of inertia in [Eq. 9.1](#) in [CSA A23.3-14](#).

[CSA A23.3-14 \(9.8.2.3\)](#)

The values of the maximum moments for the three service load levels are calculated from structural analysis as shown previously (sustained live load = 0).

$$M_{DL} = M_{DL+LL_sustained} = P_{DL} \times L = 53.00 \times 2.50 = 132.50 \text{ kN-m}$$

$$M_{DL+LL} = (P_{DL} + P_{LL}) \times L = (53.00 + 53.00) \times 2.50 = 265.00 \text{ kN-m}$$

M_{cr} = cracking moment.

$$M_{cr} = \frac{f_r \times I_g}{Y_t} = \frac{\left(\frac{3.17}{2}\right) \times (7.5660 \times 10^9)}{305.00} \times 10^{-6} = 39.38 \text{ kN-m}$$

CSA A23.3-14 (Eq. 9.2)

f_r should be taken as half of Eq. 8.3 in CSA A23.3-14

CSA A23.3-14 (9.8.2.3)

f_r = Modulus of rapture of concrete.

$$f_r = 0.6 \times \lambda \times \sqrt{f'_c} = 0.6 \times 1.00 \times \sqrt{28} = 3.17 \text{ MPa}$$

CSA A23.3-14 (Eq. 8.3)

I_g = Moment of inertia of the gross uncracked concrete section

$$I_g = \frac{b \times h^3}{12} = \frac{400.00 \times 610.00^3}{12} = 7.5660 \times 10^9 \text{ mm}^4$$

$$y_t = \frac{h}{2} = \frac{610.00}{2} = 305.00 \text{ mm}$$

I_{cr} = moment of inertia of the cracked section transformed to concrete.

CAC Concrete Design Handbook 4th Edition (5.2.3)

The critical section at midspan is reinforced with 4 – 30M bars.

Gross Section	Cracked Transformed Section	Gross and Cracked Moment of Inertia
		$n = \frac{E_s}{E_c}$ $B = \frac{b}{n \times A_s}$ $I_g = \frac{b \times h^3}{12}$ <p>Without compression steel</p> $kd = \frac{\sqrt{2 \times d \times B + 1} - 1}{B}$ $I_{cr} = \frac{b \times (kd)^3}{3} + n \times A_s \times (d - kd)^2$

Figure 5 – Gross and Cracked Moment of Inertia of Rectangular Section (PCA Notes Table 10-2)

E_c = Modulus of elasticity of concrete.

$$E_c = \left(3,300 \times \sqrt{f'_c} + 6,900 \right) \times \left(\frac{\gamma_c}{2,300} \right)^{1.5} \quad \text{CSA A23.3-14 (8.6.2.2)}$$

$$E_c = \left(3,300 \times \sqrt{28} + 6,900 \right) \times \left(\frac{2,400}{2,300} \right)^{1.5} = 25,967.93 \text{ MPa}$$

$$n = \frac{E_s}{E_c} = \frac{210,000}{25,967.93} = 8.09 \quad \text{PCA Notes on ACI 318-11 (Table 10-2)}$$

$$B = \frac{b}{n \times A_s} = \frac{400.00}{8.09 \times (4 \times 700.00)} = 0.018 \text{ mm}^{-1} \quad \text{PCA Notes on ACI 318-11 (Table 10-2)}$$

$$kd = \frac{\sqrt{2 \times d \times B + 1} - 1}{B} = \frac{\sqrt{2 \times 553.75 \times 0.018 + 1} - 1}{0.018} = 200.10 \text{ mm} \quad \text{PCA Notes on ACI 318-11 (Table 10-2)}$$

$$I_{cr} = \frac{b \times (kd)^3}{3} + n \times A_s \times (d - kd)^2 \quad \text{PCA Notes on ACI 318-11 (Table 10-2)}$$

$$I_{cr} = \frac{400.00 \times 200.10^3}{3} + 8.09 \times (4 \times 700.00) \times (553.75 - 200.10)^2 = 3.9002 \times 10^9 \text{ mm}^4$$

For Dead Load Service Load Level:

$$I_{ec} = I_{cr} + \left(I_g - I_{cr} \right) \times \left(\frac{M_{cr}}{M_a} \right)^3, \text{ since } M_{cr} = 39.38 \text{ kN-m} < M_a = 132.50 \text{ kN-m} \quad \text{CSA A23.3-14 (Eq. 9.1)}$$

$$I_e = 3.9002 \times 10^9 + (7.5660 \times 10^9 - 3.9002 \times 10^9) \times \left(\frac{39.38}{132.50} \right)^3 = 3.9965 \times 10^9 \text{ mm}^4$$

The [following Table](#) provides a summary of the required parameters and calculated values needed for deflection calculation.

Table 1 – Effective Moment of Inertia Calculations (At Support)								
I_g (mm^4) ($\times 10^9$)	I_{cr} (mm^4) ($\times 10^9$)	M_a (kN-m)			M_{cr} (kN-m)	I_e (mm^4) ($\times 10^9$)		
		D	$D + LL_{sus}$	$D + L_{full}$		D	$D + LL_{sus}$	$D + L_{full}$
7.5660	3.9002	132.50	132.50	265.00	39.38	3.9965	3.9965	3.9123

After obtaining the effective moment of inertia, the maximum span deflection for the cantilever beam (at the free end) can be obtained from any available procedures or design aids (see [Figure 3](#)).

$$\Delta_{\max} = \frac{1}{3} \times \frac{P \times L^3}{E_c \times I_e} \text{ (at the free end)}$$

$$\Delta_{DL} = \frac{1}{3} \times \frac{53.00 \times 2,500^3}{25,967.93 \times (3.9965 \times 10^9)} = 2.66 \text{ mm}$$

$$\Delta_{Total} = \frac{1}{3} \times \frac{(53.00 + 53.00) \times 2,500^3}{25,967.93 \times (3.9123 \times 10^9)} = 5.43 \text{ mm}$$

$$\Delta_{LL} = \Delta_{Total} - \Delta_{DL} = 5.43 - 2.66 = 2.77 \text{ mm} < \frac{L}{360} = \frac{2,500}{360} = 6.94 \text{ mm } o.k.$$

[CSA A23.3-14 \(Table 9.3\)](#)

6.2. Time-Dependent (Long-Term) Deflections (Δ_{lt})

The additional time-dependent (long-term) deflection resulting from creep and shrinkage (Δ_{cs}) are estimated as follows.

$$\Delta_{cs} = \lambda_{\Delta} \times (\Delta_{sust})_{Inst}$$

CSA A23.3-04 (N9.8.2.5)

The total time-dependent (long-term) deflection is calculated as:

$$(\Delta_{total})_{lt} = (\Delta_{sust})_{Inst} \times (1 + \lambda_{\Delta}) + [(\Delta_{total})_{Inst} - (\Delta_{sust})_{Inst}]$$

CSA A23.3-04 (N9.8.2.5)

Where:

$(\Delta_{sust})_{Inst}$ = Immediate (instantaneous) deflection due to sustained load, mm

$$\xi_s = \left[1 + \frac{s}{1 + 50 \times \rho'} \right]$$

CSA A23.3-14 (Eq. 9.5)

$(\Delta_{total})_{lt}$ = Time-dependent (long-term) total deflection, mm

$(\Delta_{total})_{Inst}$ = Total immediate (instantaneous) deflection, mm

For the exterior span

$s = 2$, consider the sustained load duration to be 60 months or more.

CSA A23.3-14 (9.8.2.5)

$\rho' = 0$, conservatively.

$$\lambda_{\Delta} = \frac{s}{1 + 50 \times \rho'} = \frac{2.00}{1 + 50 \times 0} = 2.00$$

CSA A23.3-04 (N9.8.2.5)

$$\Delta_{cs} = \lambda_{\Delta} \times (\Delta_{sust})_{Inst} = 2.00 \times 2.66 = 5.32 \text{ mm}$$

$$\Delta_{cs} + \Delta_{LL} = 5.32 + 2.77 = 8.09 \text{ mm} \approx \frac{L}{240} = \frac{2,500}{240} = 10.42 \text{ mm}$$

CSA A23.3-14 (Table 9.3)

$$\xi_s = \left[1 + \frac{2}{1 + 50 \times 0} \right] = 3.00$$

$$(\Delta_{total})_{lt} = 2.66 \times 3 + (5.43 - 2.66) = 10.75 \text{ mm}$$

7. Cantilever Beam Analysis and Design – spBeam Software

[spBeam](#) is widely used for analysis, design and investigation of beams, and one-way slab systems (including standard and wide module joist systems) per latest American ([ACI 318-14](#)) and Canadian ([CSA A23.3-14](#)) codes. [spBeam](#) can be used for new designs or investigation of existing structural members subjected to flexure, shear, and torsion loads. With capacity to integrate up to 20 spans and two cantilevers of wide variety of floor system types, [spBeam](#) is equipped to provide cost-effective, accurate, and fast solutions to engineering challenges.

[spBeam](#) provides top and bottom bar details including development lengths and material quantities, as well as live load patterning and immediate and long-term deflection results. Using the moment redistribution feature engineers can deliver safe designs with savings in materials and labor. Engaging this feature allows up to 20% reduction of negative moments over supports reducing reinforcement congestions in these areas.

Beam analysis and design requires engineering judgment in most situations to properly simulate the behavior of the targeted beam and take into account important design considerations such as: designing the beam as rectangular or T-shaped sections; using the effective flange width or the center-to-center distance between the beam and the adjacent beams. Regardless which of these options is selected, [spBeam](#) provide users with options and flexibility to:

1. Design the beam as a rectangular cross-section or a T-shaped section.
2. Use the effective or full beam flange width.
3. Include the flanges effects in the deflection calculations.
4. Invoke moment redistribution to lower negative moments
5. Using gross (uncracked) or effective (cracked) moment of inertia

For illustration and comparison purposes, the [following figures](#) provide a sample of the results obtained from an [spBeam](#) model created for the cantilever beam discussed in this example.

spBeam - DE-Cantilever-Beam-CSA-14.slbx

File Home

Project Define Grid Select Spans Supports Loads Rebars Solve Results Tables Reporter Display Viewports Settings

SELECT

SPAN

Span	2
No. of selected	1

Elements Loads

Point Loads

	Fz	Torque	Moment	L
	kN	kNm	kNm	m
1	53.00	0.00	0.00	2.50

Area Loads

Line Loads

Lateral Load Effects


OPTIONS

Distance location as ratio of span


DISPLAY OPTIONS

Load Case A - Dead

Model View (Load Case: A - Dead)

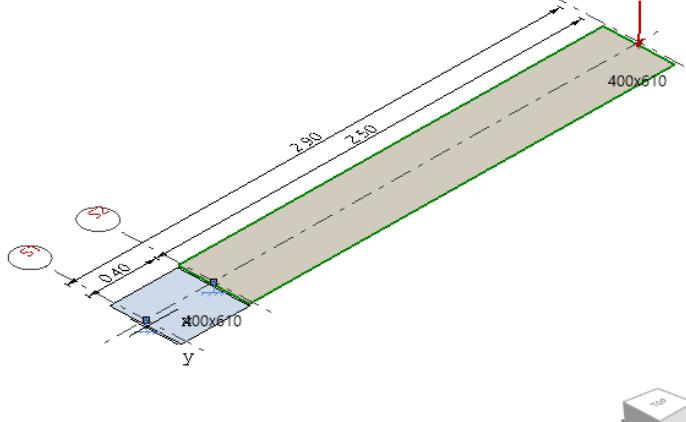


Model View (Load Case: B - Live)

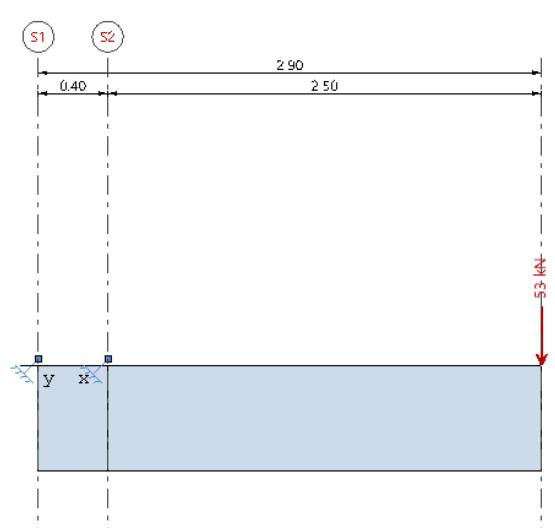

14 One-Way/Beam Design X: 3.54 (m) Units: Metric



spBeam v10.00 (TM)
A Computer Program for Analysis, Design, and Investigation of
Reinforced Concrete Beams and One-way Slab Systems
Copyright © 1988-2024, STRUCTUREPOINT, LLC.
All rights reserved

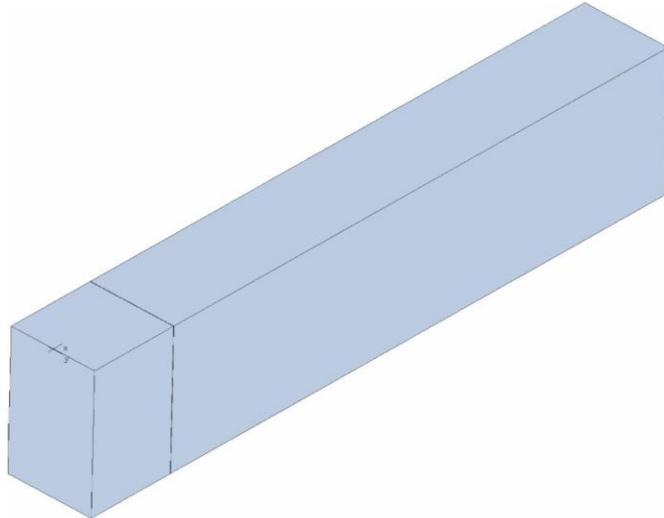

StructurePoint

Licensee stated above acknowledges that STRUCTUREPOINT (SP) is not and cannot be responsible for either the accuracy or adequacy of the material supplied as input for processing by the spBeam computer program. Furthermore, STRUCTUREPOINT neither makes any warranty expressed nor implied with respect to the correctness of the output prepared by the spBeam program. Although STRUCTUREPOINT has endeavored to produce spBeam error free the program is not and cannot be certified infallible. The final and only responsibility for analysis, design and engineering documents is the licensee's. Accordingly, STRUCTUREPOINT disclaims all responsibility in contract, negligence or other tort for any analysis, design or engineering documents prepared in connection with the use of the spBeam program. Licensed to: StructurePoint, LLC. License ID: 00000-0000000-4-1C985-1C985

Contents

1. Input Echo.....	3
1.1. General Information.....	3
1.2. Solve Options	3
1.3. Material Properties	3
1.3.1. Concrete: Slabs / Beams	3
1.3.2. Concrete: Columns	3
1.3.3. Reinforcing Steel.....	3
1.4. Reinforcement Database	4
1.5. Span Data	4
1.5.1. Slabs	4
1.5.2. Ribs and Longitudinal Beams	4
1.6. Support Data	4
1.6.1. Columns	4
1.6.2. Boundary Conditions.....	4
1.7. Load Data	4
1.7.1. Load Cases and Combinations.....	4
1.7.2. Point Forces	5
1.8. Reinforcement Criteria	5
1.8.1. Slabs and Ribs	5
1.8.2. Beams	5
2. Design Results.....	5
2.1. Top Reinforcement.....	5
2.2. Top Bar Details.....	5
2.3. Top Bar Development Lengths	6
2.4. Bottom Reinforcement.....	6
2.5. Bottom Bar Details	6
2.6. Bottom Bar Development Lengths	6
2.7. Flexural Capacity.....	6
2.8. Longitudinal Beam Transverse Reinforcement Demand and Capacity	7
2.8.1. Section Properties.....	7
2.8.2. Beam Transverse Reinforcement Demand	7
2.8.3. Beam Transverse Reinforcement Details	7
2.8.4. Beam Transverse Reinforcement Capacity	7
2.9. Slab Shear Capacity.....	7
2.10. Material TakeOff.....	7
2.10.1. Reinforcement in the Direction of Analysis	7
3. Deflection Results: Summary	8
3.1. Section Properties	8
3.1.1. Frame Section Properties	8
3.1.2. Frame Effective Section Properties	8
3.2. Instantaneous Deflections	8
3.2.1. Extreme Instantaneous Frame Deflections and Corresponding Locations	8
3.3. Long-term Deflections	8
3.3.1. Long-term Deflection Factors	8
3.3.2. Extreme Long-term Frame Deflections and Corresponding Locations	9
4. Screenshots	10
4.1. Extrude 3D view	10
4.2. Loads - Case A - Dead	11
4.3. Loads - Case B - Live	12
4.4. Internal Forces	13
4.5. Moment Capacity	14
4.6. Shear Capacity	15
4.7. Deflection	16
4.8. Reinforcement	17

STRUCTUREPOINT - spBeam v10.00 (TM)
 Licensed to: StructurePoint, LLC. License ID: 00000-0000000-4-1C985-1C985
 C:\StructurePoint\spBeam\DE-Cantilever-Beam-CSA-14.slbx

Page | 3
 12/18/2025
 5:40 PM

1. Input Echo

1.1. General Information

File Name	C:\StructurePoi...lDE-Cantilever-Beam-CSA-14.slbx
Project	RC Cantilever Beam
Frame	RC Cantilever Beam
Engineer	SP
Code	CSA A23.3-14
Units	Metric
Reinforcement Database	CSA G30.18
Mode	Design
Number of supports =	2 + Right Cantilever
Floor System	One-Way/Beam

1.2. Solve Options

Live load pattern ratio = 0%
Deflections are based on cracked section properties.
In negative moment regions, Ig and Mcr DO NOT include flange/slab contribution (if available)
Long-term deflections are calculated for load duration of 60 months.
0% of live load is sustained.
Compression reinforcement calculations NOT selected.
Default incremental rebar design selected.
Combined M-V-T reinforcement design NOT selected.
Moment redistribution NOT selected.
Effective flange width calculations NOT selected.
Rigid beam-column joint NOT selected.
Torsion analysis and design NOT selected.

1.3. Material Properties

1.3.1. Concrete: Slabs / Beams

w _c	2400 kg/m ³
f' _c	28 MPa
E _c	25967.9 MPa
f _r	1.58745 MPa
Precast concrete	No

1.3.2. Concrete: Columns

w _c	2400 kg/m ³
f' _c	28 MPa
E _c	25967.9 MPa
f _r	3.1749 MPa
Precast concrete	No

1.3.3. Reinforcing Steel

f _y	400 MPa
f _{yt}	400 MPa
E _s	210000 MPa

STRUCTUREPOINT - spBeam v10.00 (TM)
 Licensed to: StructurePoint, LLC. License ID: 00000-0000000-4-1C985-1C985
 C:\StructurePoint\spBeam\DE-Cantilever-Beam-CSA-14.slbx

Page | 4
 12/18/2025
 5:40 PM

Epoxy coated bars	No
-------------------	----

1.4. Reinforcement Database

Size	Db mm	Ab mm ²	Wb kg/m	Size	Db mm	Ab mm ²	Wb kg/m
#10	11	100	1	#15	16	200	2
#20	20	300	2	#25	25	500	4
#30	30	700	5	#35	36	1000	8
#45	44	1500	12	#55	56	2500	20

1.5. Span Data

1.5.1. Slabs

Notes:

Span	Loc	L1 m	t mm	wL m	wR m	H _{min} mm
1	Int	0.400	0	0.200	0.200	0 ---
2	Int	2.500	0	0.200	0.200	0 RC

1.5.2. Ribs and Longitudinal Beams

Notes:

*c - Deep beam. Additional design and bar detailing required.

Span	Ribs			Beams		Span H _{min} mm
	b mm	h mm	Sp mm	b mm	h mm	
1	0	0	0	400	610	25 *c
2	0	0	0	400	610	313

1.6. Support Data

1.6.1. Columns

Support	c1a mm	c2a mm	Ha m	c1b mm	c2b mm	Hb m	Red %
1	0	0	0.000	0	0	0.000	999
2	0	0	0.000	0	0	0.000	999

1.6.2. Boundary Conditions

Support	Spring		Far End	
	K _z kN/mm	K _{ry} kN-mm/rad	Above	Below
1	0.00	0.00	Fixed	Fixed
2	0.00	0.00	Fixed	Fixed

1.7. Load Data

1.7.1. Load Cases and Combinations

Case	Dead	Live
Type	DEAD	LIVE
U1	1.250	1.500

STRUCTUREPOINT - spBeam v10.00 (TM)
 Licensed to: StructurePoint, LLC. License ID: 00000-0000000-4-1C985-1C985
 C:\StructurePoint\spBeam\DE-Cantilever-Beam-CSA-14.slbx

Page | 5
 12/18/2025
 5:40 PM

1.7.2. Point Forces

Case/Patt	Span	Wa kN	La m
Dead	2	53.00	2.500
Live	2	53.00	2.500

1.8. Reinforcement Criteria

1.8.1. Slabs and Ribs

	Units	Top Bars		Bottom Bars	
		Min.	Max.	Min.	Max.
Bar Size		#20	#35	#20	#35
Bar spacing	mm	25	457	25	457
Reinf ratio	%	0.14	5.00	0.14	5.00
Clear Cover	mm	38	38		

There is NOT more than 300 mm of concrete below top bars.

1.8.2. Beams

	Units	Top Bars		Bottom Bars		Stirrups	
		Min.	Max.	Min.	Max.	Min.	Max.
Bar Size		#30	#30	#30	#30	#10	#10
Bar spacing	mm	25	457	25	457	152	457
Reinf ratio	%	0.14	2.63	0.14	2.63		
Clear Cover	mm	41	41				
Layer dist.	mm	25		25			
No. of legs						2	6
Side cover	mm					30	
1st Stirrup	mm					76	

There is NOT more than 300 mm of concrete below top bars.

2. Design Results

2.1. Top Reinforcement

Notes:

*3 - Design governed by minimum reinforcement.

Span Zone	Width m	M _{max} kNm	X _{max} m	A _{s,min} mm ²	A _{s,max} mm ²	A _{s,req} mm ²	Sp _{Prov} mm	Bars
1 Left	0.40	0.00	0.000	0	5487	0	0	---
	0.40	0.00	0.140	0	5487	0	0	---
	0.40	0.00	0.400	646	5487	0	94	4-#30 *3
2 Left	0.40	364.38	0.000	646	5487	2184	94	4-#30
	0.40	236.84	0.875	646	5487	1354	94	4-#30
	0.40	127.53	1.625	646	5487	703	94	4-#30

2.2. Top Bar Details

Span	Bars	Left		Continuous		Right			
		Length m	Bars	Length m	Bars	Length m	Bars	Length m	Bars
1	---	---	---	---	---	0.40	2-#30	0.40	2-#30
2	---	---	---	4-#30	2.50	---	---	---	---

2.3. Top Bar Development Lengths

Span	Bars	Left		Continuous		Right	
		DevLen mm	Bars	DevLen mm	Bars	DevLen mm	Bars
1	---	---	---	---	---	2-#30	300.00
2	---	---	---	4-#30	524.59	---	---

2.4. Bottom Reinforcement

Span	Width m	M _{max} kNm	X _{max} m	A _{s,min} mm ²	A _{s,max} mm ²	A _{s,req} mm ²	S _{p,prov} mm	Bars
1	0.40	0.00	0.400	0	5487	0	0	---
2	0.40	0.00	1.250	0	5487	0	0	---

2.5. Bottom Bar Details

Span	Long Bars			Short Bars		
	Bars	Start	Length	Bars	Start	Length
1	---	---	---	---	---	---
2	---	---	---	---	---	---

2.6. Bottom Bar Development Lengths

Span	Long Bars		Short Bars	
	Bars	DevLen mm	Bars	DevLen mm
1	---	---	---	---
2	---	---	---	---

2.7. Flexural Capacity

Span	x m	A _{s,top} mm ²	Top			Bottom					
			ΦM _{n,-} kNm	M _{u,-} kNm	Comb Pat	Status	A _{s,bot} mm ²	ΦM _{n,+} kNm	M _{u,+} kNm	Comb Pat	Status
1	0.000	2800	-450.13	0.00	U1 All	OK	0	0.00	0.00	U1 All	OK
	0.140	2800	-450.13	0.00	U1 All	OK	0	0.00	0.00	U1 All	OK
	0.200	2800	-450.13	0.00	U1 All	OK	0	0.00	0.00	U1 All	OK
	0.260	2800	-450.13	0.00	U1 All	OK	0	0.00	0.00	U1 All	OK
	0.300	2800	-450.13	0.00	U1 All	OK	0	0.00	0.00	U1 All	OK
	0.400	2800	-450.13	0.00	U1 All	OK	0	0.00	0.00	U1 All	OK
2	0.000	2800	-450.13	-364.38	U1 All	OK	0	0.00	0.00	U1 All	OK
	0.875	2800	-450.13	-236.84	U1 All	OK	0	0.00	0.00	U1 All	OK
	1.250	2800	-450.13	-182.19	U1 All	OK	0	0.00	0.00	U1 All	OK
	1.625	2800	-450.13	-127.53	U1 All	OK	0	0.00	0.00	U1 All	OK
	2.500	2800	-450.13	0.00	U1 All	OK	0	0.00	0.00	U1 All	OK

2.8. Longitudinal Beam Transverse Reinforcement Demand and Capacity

2.8.1. Section Properties

Span	d_v mm	$(A_v/s)_{min}$ mm ² /mm	ΦV_c kN	$V_{r,max}$ kN
1	498.4	0.317	123.42	907.04
2	498.4	0.317	123.42	907.04

2.8.2. Beam Transverse Reinforcement Demand

Notes:

*8 - Minimum transverse (stirrup) reinforcement governs.

Span	Start m	End m	Required			Demand A_v/s mm ² /mm
			X_u m	V_u kN	Comb/Patt	
1	0.076	0.324	0.200	0.00	U1/All	0.000
2	0.076	1.166	0.498	145.75	U1/All	0.092
	1.166	1.833	1.166	145.75	U1/All	0.092
	1.833	2.500	1.833	145.75	U1/All	0.092

2.8.3. Beam Transverse Reinforcement Details

Span Size Stirrups (2 legs each unless otherwise noted)

- 1 #10 --- None ---
- 2 #10 8 @ 335

2.8.4. Beam Transverse Reinforcement Capacity

Notes:

*8 - Minimum transverse (stirrup) reinforcement governs.

Span	Start m	End m	Required			Reqd/Min	Provided			
			X_u m	V_u kN	Comb/Patt		A_v/s mm ² /mm	A_v mm ²	Sp mm	ΦV_n kN
1	0.000	0.400	0.200	0.00	U1/All	0.000	0.00	----	----	105.25
2	0.000	0.076	0.498	145.75	U1/All	----	----	----	----	----
	0.076	2.424	0.498	145.75	U1/All	0.092	0.29	200.0	335	0.596
	2.424	2.500	2.424	145.75	U1/All	----	----	----	----	----

2.9. Slab Shear Capacity

Span	b mm	d_v mm	β	V_{ratio}	ΦV_c kN	V_u kN	X_u m
1	---	Not checked ---					
2	---	Not checked ---					

2.10. Material TakeOff

2.10.1. Reinforcement in the Direction of Analysis

Top Bars	63.7 kg	<=>	21.98 kg/m	<=>	54.950 kg/m ²
Bottom Bars	0.0 kg	<=>	0.00 kg/m	<=>	0.000 kg/m ²
Stirrups	11.0 kg	<=>	3.79 kg/m	<=>	9.463 kg/m ²
Total Steel	74.7 kg	<=>	25.77 kg/m	<=>	64.413 kg/m ²
Concrete	0.7 m ³	<=>	0.24 m ³ /m	<=>	0.610 m ³ /m ²

3. Deflection Results: Summary

3.1. Section Properties

3.1.1. Frame Section Properties

Notes:

M+ve values are for positive moments (tension at bottom face).
 M-ve values are for negative moments (tension at top face).

Span Zone	M+ve				M-ve			
	I _g mm ⁴	I _{cr} mm ⁴	M _{cr} kNm	I _g mm ⁴	I _{cr} mm ⁴	M _{cr} kNm		
1 Left	7566033333.33	0.00	39.38	7566033333.33	0.00	39.38		
	7566033333.33	0.00	39.38	7566033333.33	3900228938.34	-39.38		
	7566033333.33	0.00	39.38	7566033333.33	3900228938.34	-39.38		
2 Left	7566033333.33	0.00	39.38	7566033333.33	3900228938.34	-39.38		
	7566033333.33	0.00	39.38	7566033333.33	3900228938.34	-39.38		
	7566033333.33	0.00	39.38	7566033333.33	3900228938.34	-39.38		

3.1.2. Frame Effective Section Properties

Span Zone	Weight	Load Level							
		Dead		Sustained		Dead+Live			
		M _{max} kNm	I _e mm ⁴	M _{max} kNm	I _e mm ⁴	M _{max} kNm	I _e mm ⁴		
1 Left	0.150	0.00	7566033333.33	0.00	7566033333.33	0.00	7566033333.33		
Middle	0.700	0.00	7566033333.33	0.00	7566033333.33	0.00	7566033333.33		
Right	0.150	0.00	7566033333.33	0.00	7566033333.33	0.00	7566033333.33		
Span Avg	---	---	7566033333.33	---	7566033333.33	---	7566033333.33		
2 Left	1.000	-132.50	3996462751.99	-132.50	3996462751.99	-265.00	3996462751.99		
Span Avg	---	---	3996462751.99	---	3996462751.99	---	3996462751.99		

3.2. Instantaneous Deflections

3.2.1. Extreme Instantaneous Frame Deflections and Corresponding Locations

Span	Direction	Value	Units	Live				Total		
				Dead	Sustained	Unsustained	Total	Sustained	Dead+Live	
1	Down	Def	mm	---	---	---	---	---	---	---
		Loc	m	---	---	---	---	---	---	---
	Up	Def	mm	---	---	---	---	---	---	---
		Loc	m	---	---	---	---	---	---	---
2	Down	Def	mm	2.66	---	2.77	2.77	2.66	5.43	
		Loc	m	2.500	---	2.500	2.500	2.500	2.500	
	Up	Def	mm	---	---	---	---	---	---	---
		Loc	m	---	---	---	---	---	---	---

3.3. Long-term Deflections

3.3.1. Long-term Deflection Factors

Notes:

Deflection multiplier, Lambda, depends on moment sign at sustained load level and Rho' in given zone.
 Rho' is assumed zero because Compression Reinforcement option is NOT selected in Solve Options.

Time dependant factor for sustained loads = 2.000

Span Zone	M+ve				M-ve				
	A _{s,top} mm ²	b mm	d mm	Rho' Lambda	A _{s,bot} mm ²	b mm	d mm	Rho' Lambda	
1 Midspan	---	---	---	0.000	2.000	---	---	0.000	2.000
2 Left	---	---	---	0.000	2.000	---	---	0.000	2.000

3.3.2. Extreme Long-term Frame Deflections and Corresponding Locations

Notes:

Incremental deflections due to creep and shrinkage (cs) based on sustained load level values.
Incremental deflections after partitions are installed can be estimated by deflections due to:
- creep and shrinkage plus unsustained live load (cs+lu), if live load applied before partitions,
- creep and shrinkage plus live load (cs+l), if live load applied after partitions.
Total deflections consist of dead, live, and creep and shrinkage deflections.


Span	Direction	Value	Units	cs	cs+lu	cs+l	Total
1	Down	Def	mm	---	---	---	---
		Loc	m	---	---	---	---
	Up	Def	mm	---	---	---	---
		Loc	m	---	---	---	---
2	Down	Def	mm	5.32	8.09	8.09	10.75
		Loc	m	2.500	2.500	2.500	2.500
	Up	Def	mm	---	---	---	---
		Loc	m	---	---	---	---

STRUCTUREPOINT - spBeam v10.00 (TM)
Licensed to: StructurePoint, LLC. License ID: 00000-0000000-4-1C985-1C985
C:\StructurePoint\spBeam\DE-Cantilever-Beam-CSA-14.slbx

Page | 10
12/18/2025
5:40 PM

4. Screenshots


4.1. Extrude 3D view

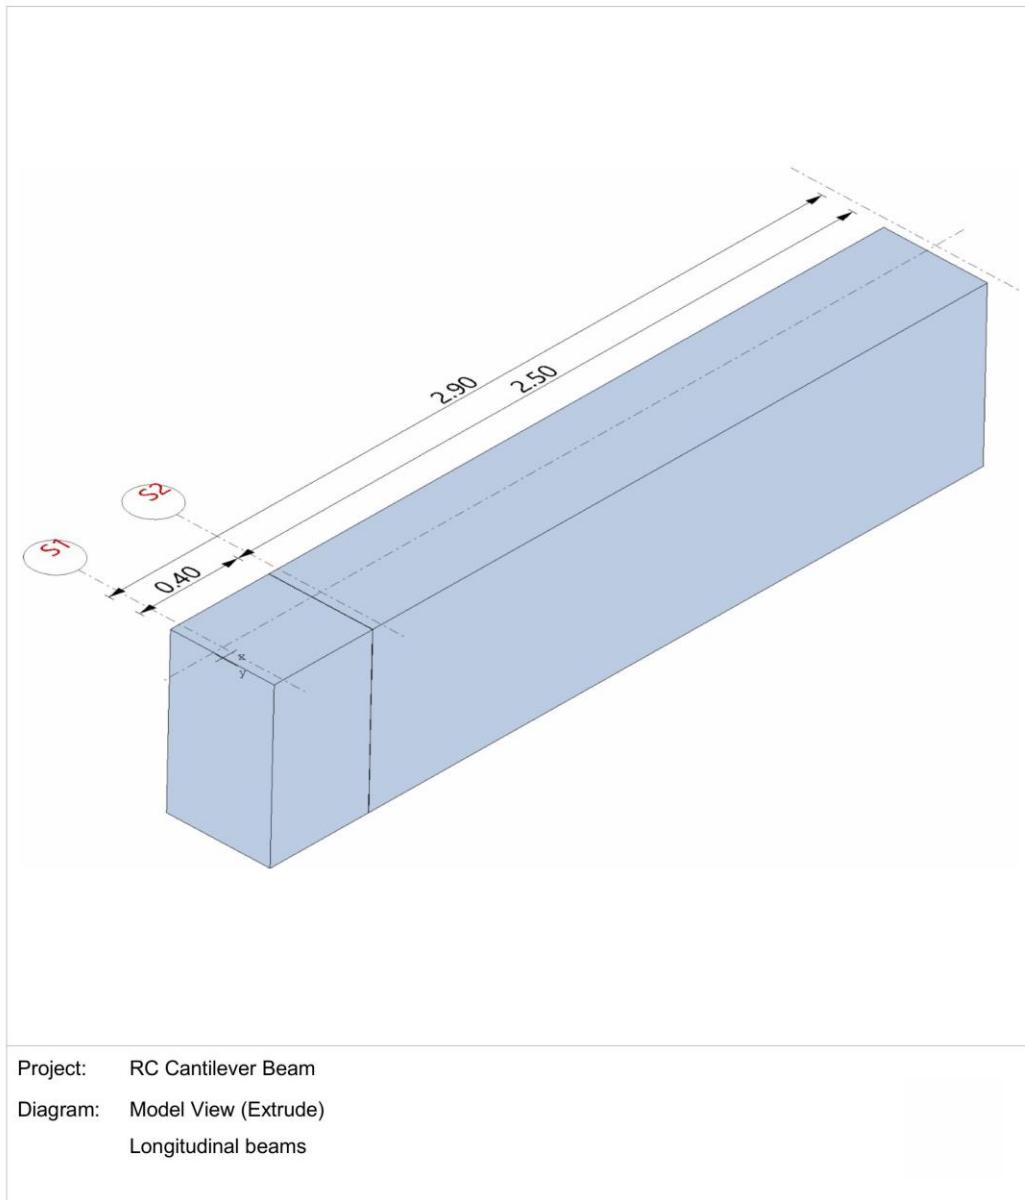

STRUCTUREPOINT - spBeam v10.00 (TM)
Licensed to: StructurePoint, LLC. License ID: 00000-0000000-4-1C985-1C985
C:\StructurePoint\spBeam\DE-Cantilever-Beam-CSA-14.slbx

Page | 11
12/18/2025
5:40 PM


4.2. Loads - Case A - Dead

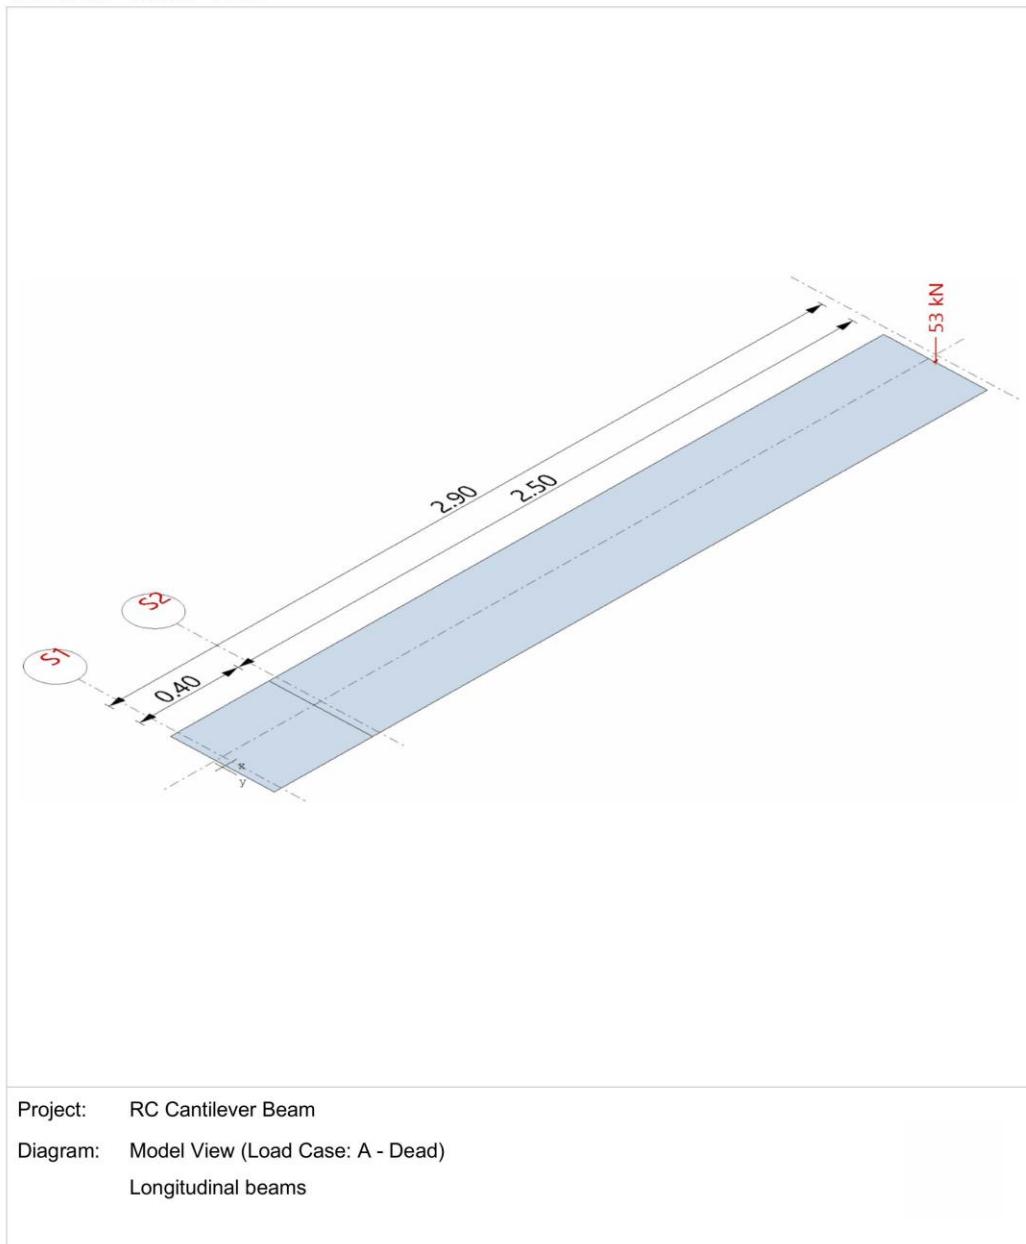

STRUCTUREPOINT - spBeam v10.00 (TM)
Licensed to: StructurePoint, LLC. License ID: 00000-0000000-4-1C985-1C985
C:\StructurePoint\spBeam\DE-Cantilever-Beam-CSA-14.slbx

Page | 12
12/18/2025
5:40 PM


4.3. Loads - Case B - Live

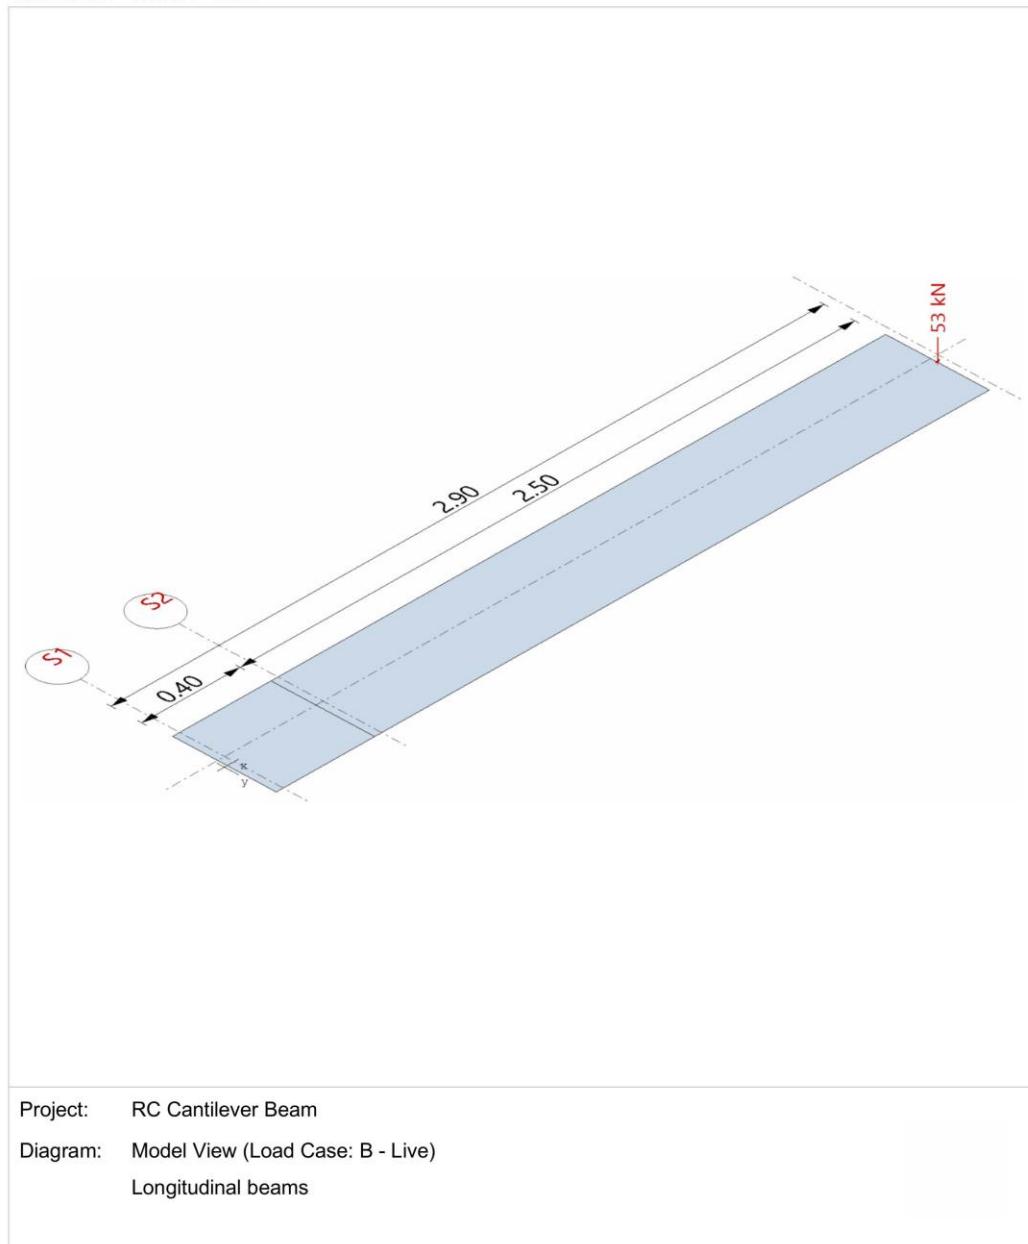

STRUCTUREPOINT - spBeam v10.00 (TM)
 Licensed to: StructurePoint, LLC. License ID: 00000-0000000-4-1C985-1C985
 C:\StructurePoint\spBeam\DE-Cantilever-Beam-CSA-14.slbx

Page | 13
 12/18/2025
 5:40 PM


4.4. Internal Forces

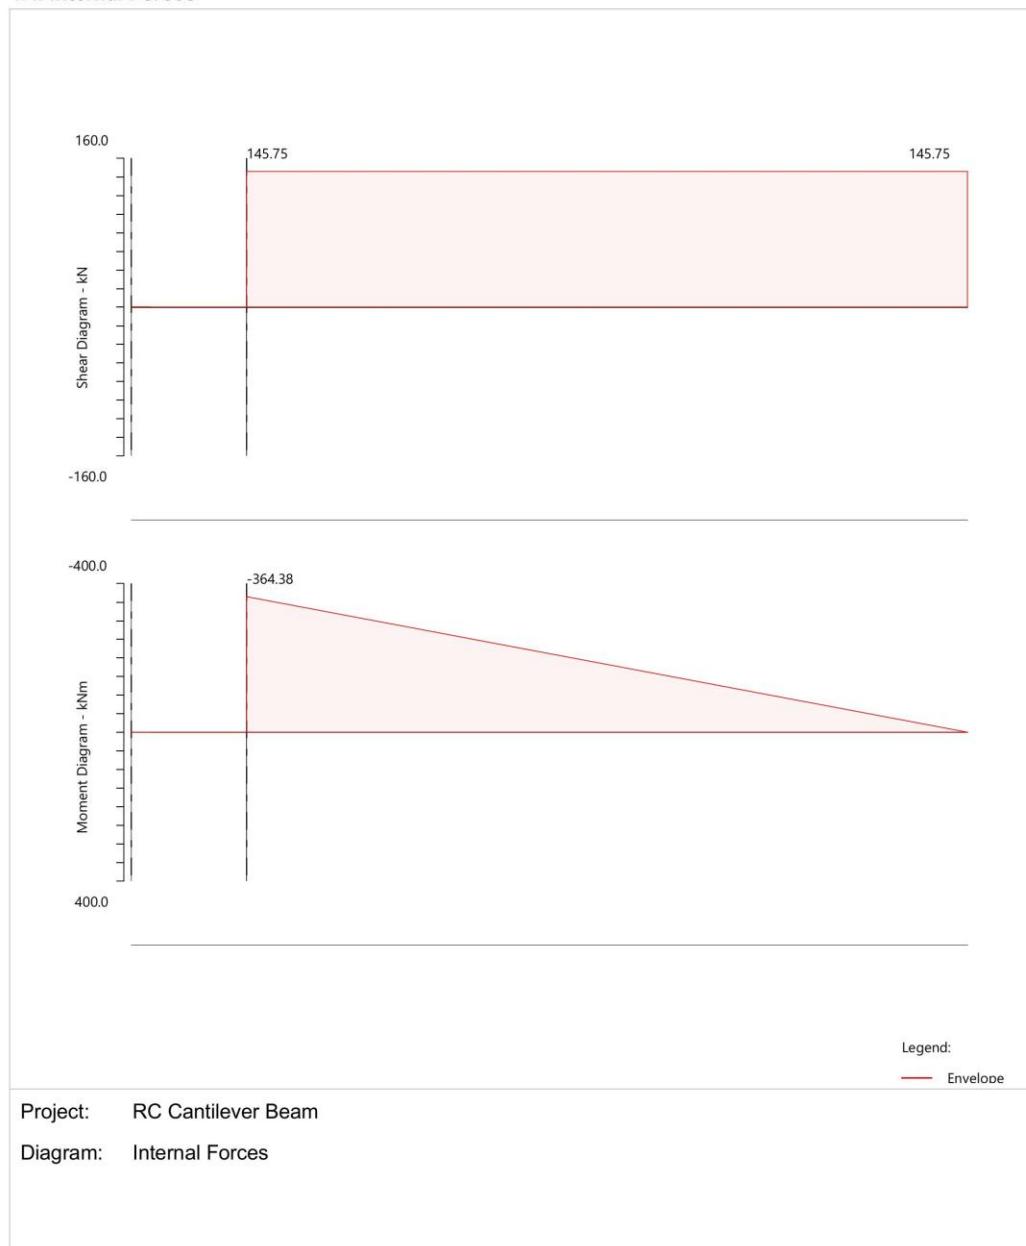

STRUCTUREPOINT - spBeam v10.00 (TM)
Licensed to: StructurePoint, LLC. License ID: 00000-0000000-4-1C985-1C985
C:\StructurePoint\spBeam\DE-Cantilever-Beam-CSA-14.slbx

Page | 14
12/18/2025
5:40 PM


4.5. Moment Capacity

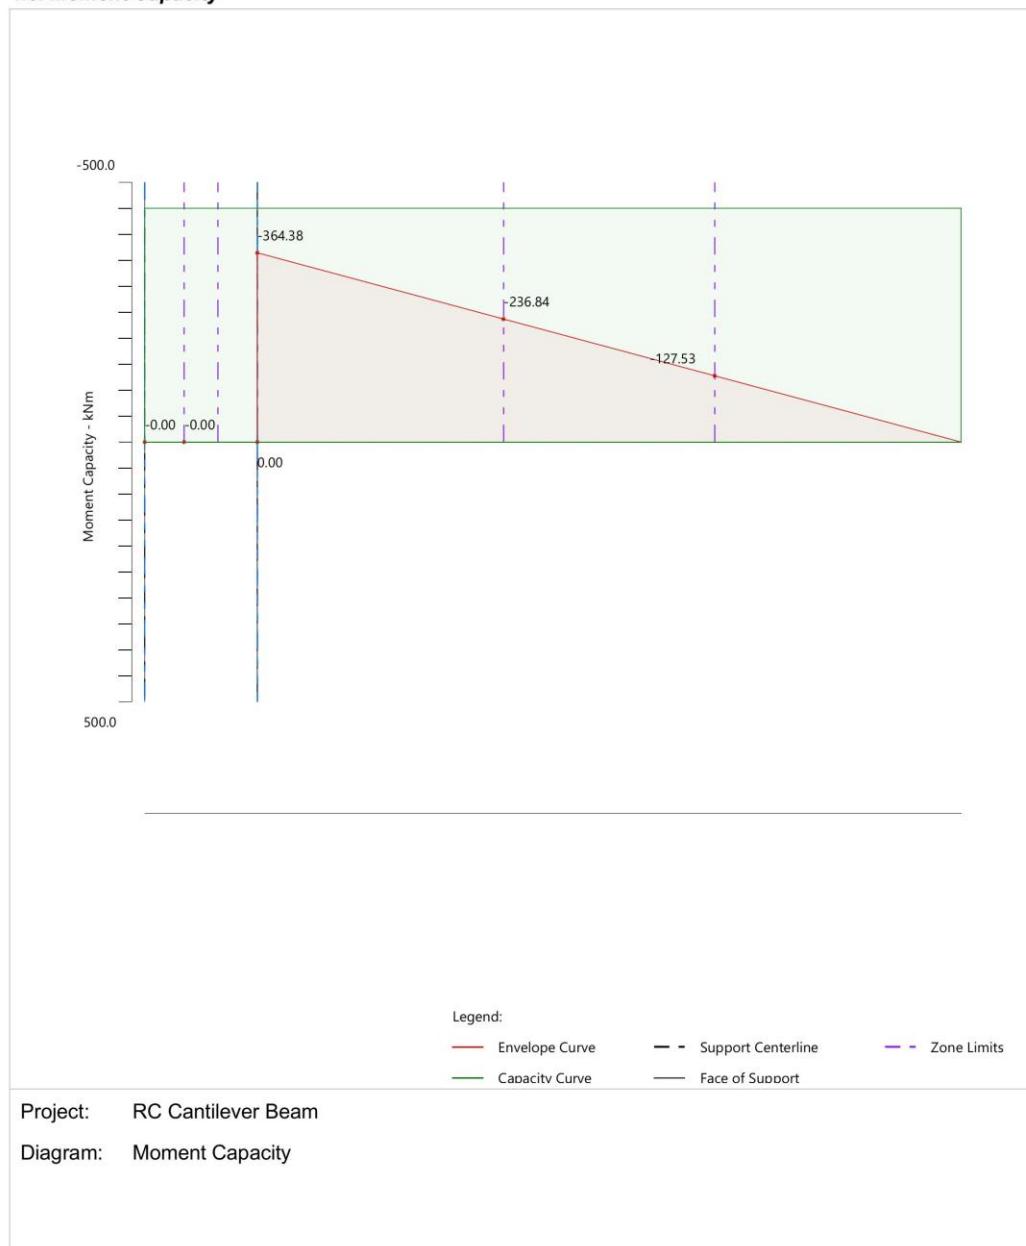

STRUCTUREPOINT - spBeam v10.00 (TM)
 Licensed to: StructurePoint, LLC. License ID: 00000-0000000-4-1C985-1C985
 C:\StructurePoint\spBeam\DE-Cantilever-Beam-CSA-14.slbx

Page | 15
 12/18/2025
 5:40 PM


4.6. Shear Capacity

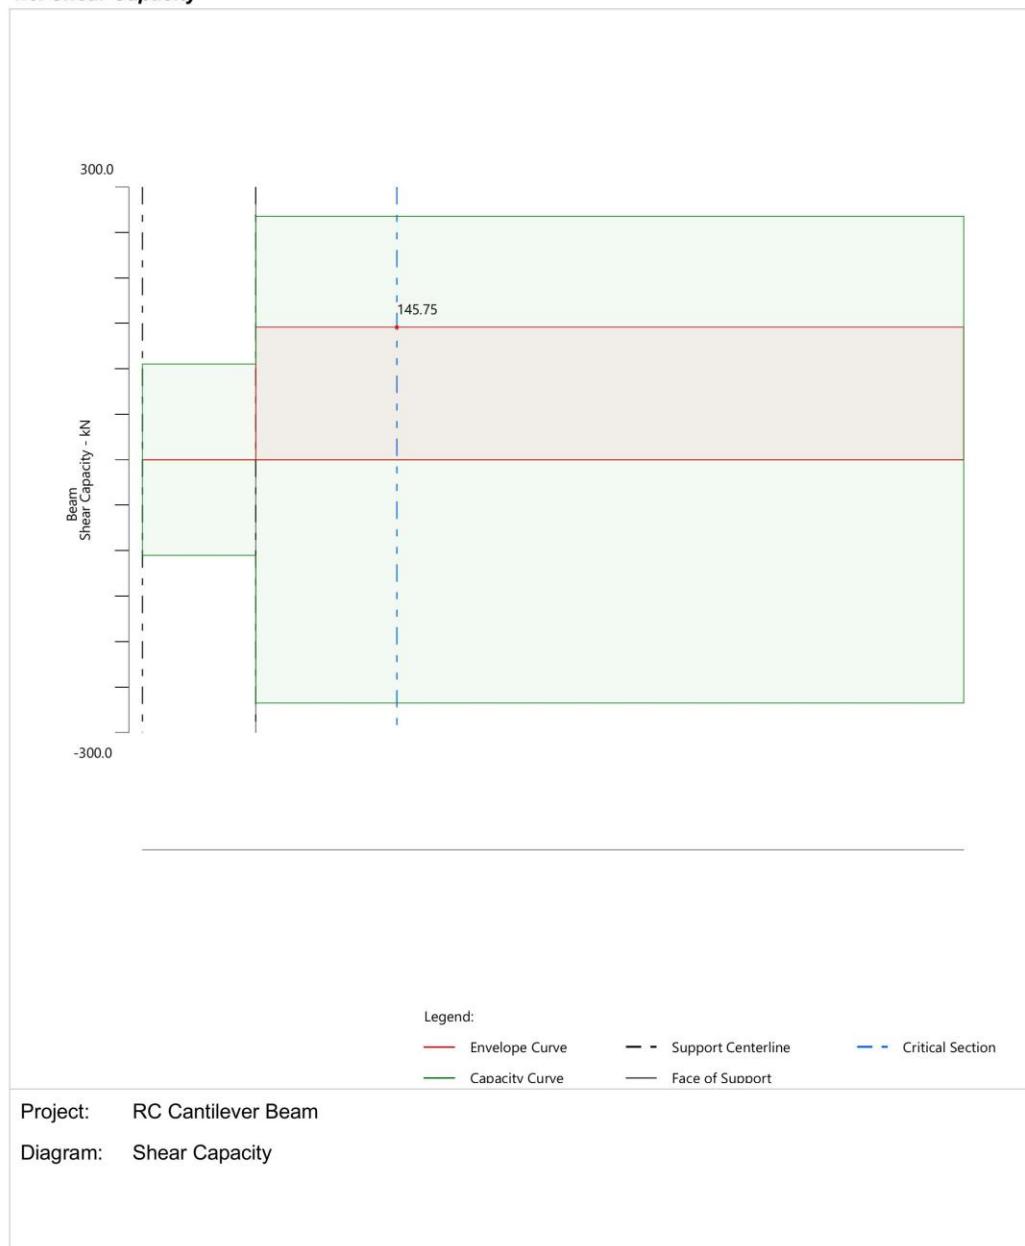

STRUCTUREPOINT - spBeam v10.00 (TM)
Licensed to: StructurePoint, LLC. License ID: 00000-0000000-4-1C985-1C985
C:\StructurePoint\spBeam\DE-Cantilever-Beam-CSA-14.slbx

Page | 16
12/18/2025
5:40 PM


4.7. Deflection

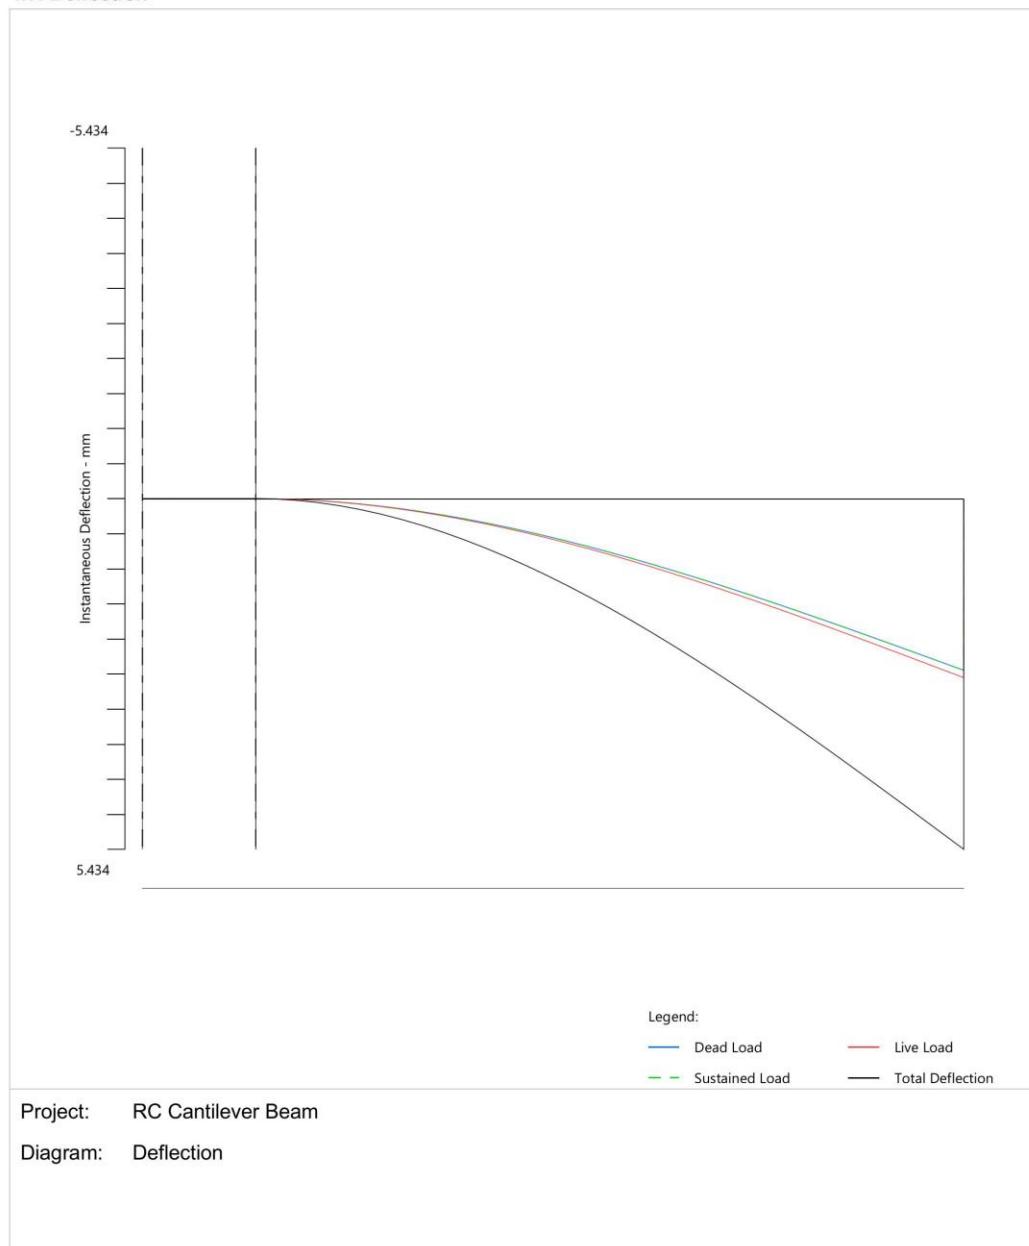

STRUCTUREPOINT - spBeam v10.00 (TM)
 Licensed to: StructurePoint, LLC. License ID: 00000-0000000-4-1C985-1C985
 C:\StructurePoint\spBeam\DE-Cantilever-Beam-CSA-14.slbx

Page | 17
 12/18/2025
 5:40 PM

4.8. Reinforcement

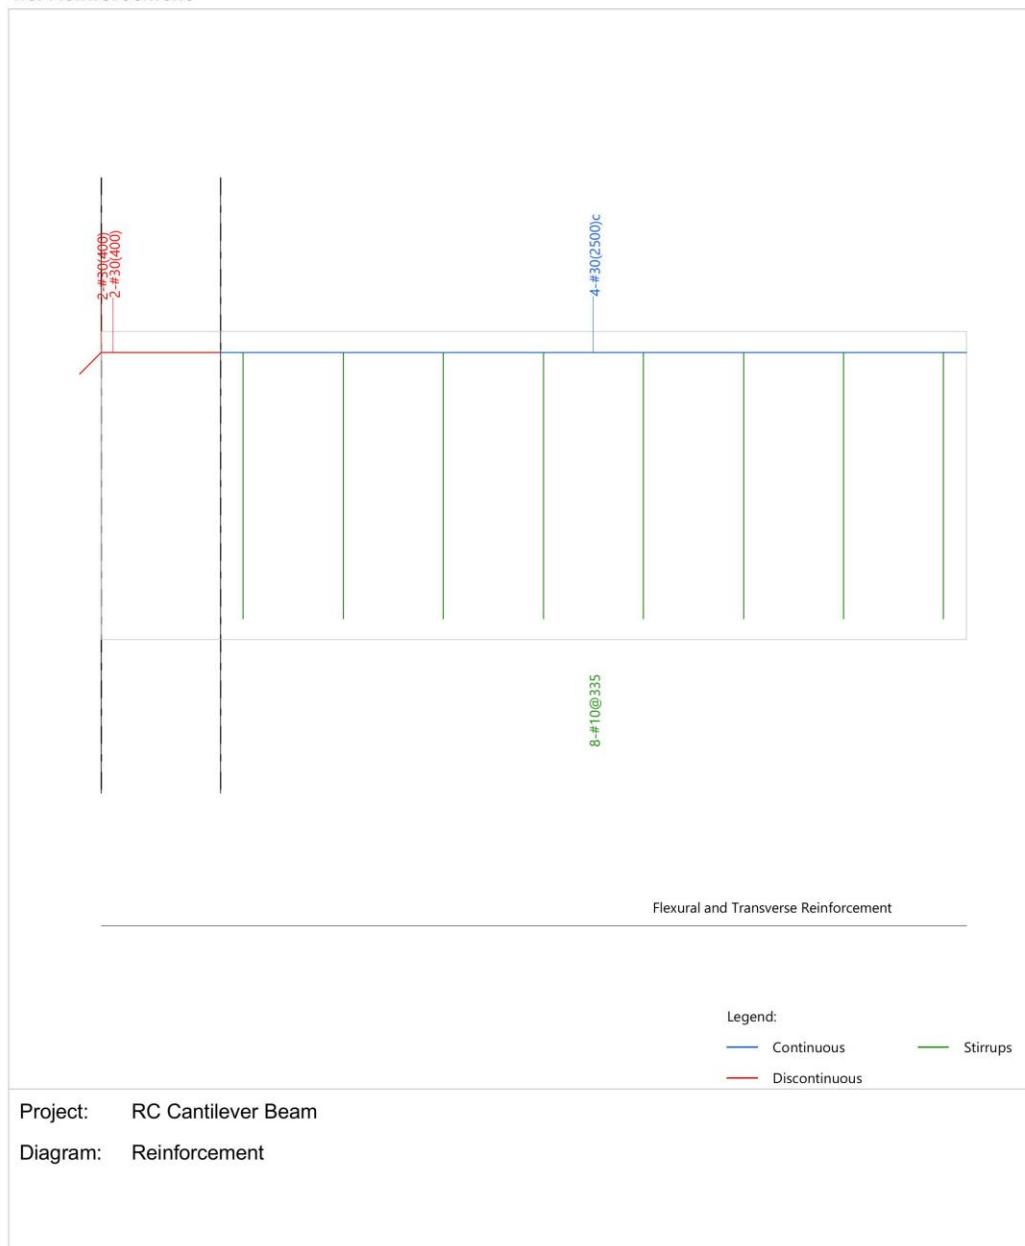

8. Analysis and Design Results Comparison and Conclusions

The following tables show the comparison between hand results and [spBeam](#) model results.

Table 2 – Comparison of Moments and Flexural Reinforcement (At Fixed End)

Location	M_f (kN-m)	Reinforcement	$A_{s,provided}$ (mm ²)	M_r (kN-m)
Hand	364.38	4 – 30M	2,800.00	450.13
spBeam	364.38	4 – 30M	2,800.00	450.13

Table 3 – Comparison of Shear and lateral Reinforcement

V_f^* (kN)		$(A_{w/s})_{req}^{**}$ (mm ² /mm)		$(A_{w/s})_{min}^{**}$ (mm ² /mm)		Reinforcement		V_r (kN)	
Hand	spBeam	Hand	spBeam	Hand	spBeam	Hand	spBeam	Hand	spBeam
145.75	145.75	0.092	0.092	0.317	0.317	10M @ 335 mm	10M @ 335 mm	267.89	267.73

* Shear values are taken at distance d_v from the faces of supports
** Minimum transverse reinforcement governs

Table 4 – Comparison of Section Properties

Location	I_{cr} (mm ⁴) ($\times 10^9$)		I_e (mm ⁴) ($\times 10^9$)					
	Hand	spBeam	Hand			spBeam		
			DL	$DL+LL_{sus}$	Total	DL	$DL+LL_{sus}$	Total
Midspan	3.9002	3.9002	3.9965	3.9965	3.9123	3.9965	3.9965	3.9123

Table 5 – Comparison of Maximum Instantaneous Deflection (At Free End) (mm)

Deflection Type	Hand	spBeam
Δ_{DL}	2.66	2.66
Δ_{LL}	2.77	2.77
Δ_{total}	5.43	5.43

Table 6 – Comparison of Maximum Long-Term Deflection (At Free End) (mm)

Deflection Type	Hand	spBeam
Δ_{cs}	5.32	5.32
$\Delta_{cs} + \Delta_{LL}$	8.09	8.09
$(\Delta_{total})_{lt}$	10.75	10.75

The results of all the hand calculations used illustrated above are in agreement with the automated exact results obtained from the [spBeam](#) program.