
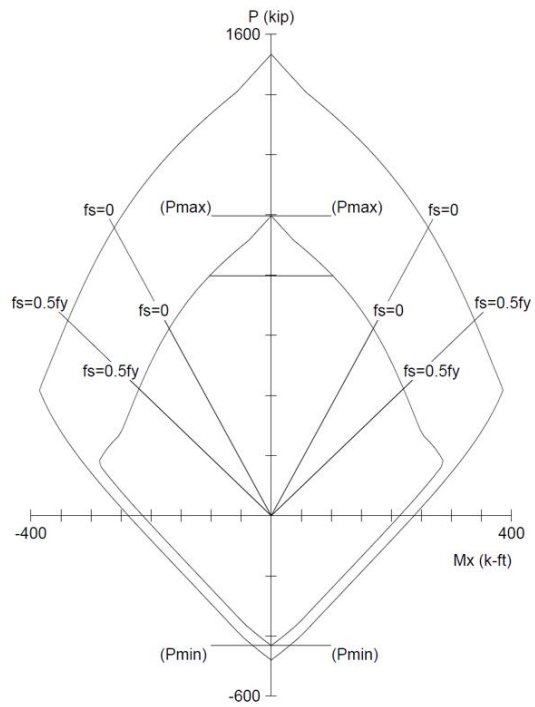
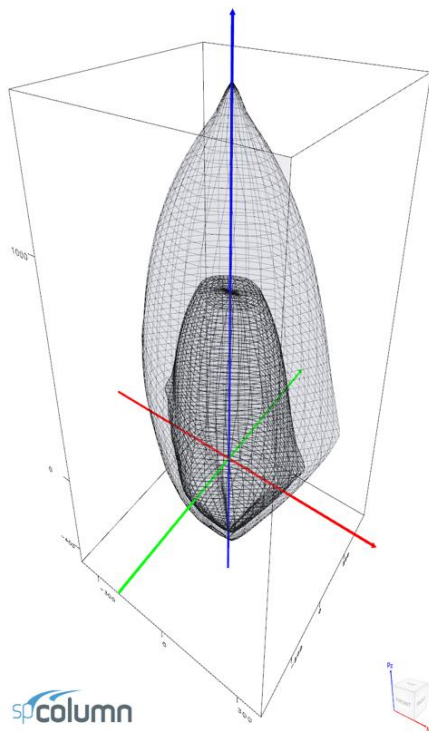


Interaction Diagram - Tied Reinforced Concrete Column with High-Strength Reinforcing Bars (ACI 318-19)

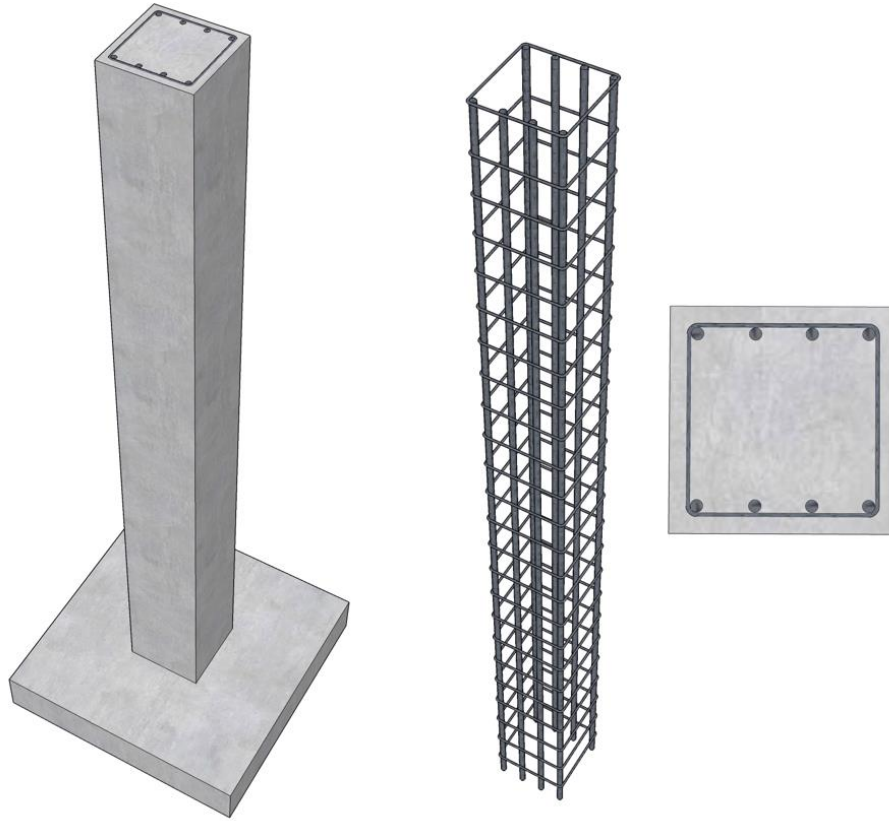

Interaction Diagram - Tied Reinforced Concrete Column with High-Strength Reinforcing Bars (ACI 318-19)

Develop an interaction diagram for the square tied concrete column shown in the figure below about the x-axis using ACI 318-19. Determine seven control points on the interaction diagram and compare the calculated values with exact values from the complete interaction diagram generated by [spColumn](#) engineering software program from [StructurePoint](#). High Strength Reinforcing Bars (HSRB) with Grade 80 steel ($f_y = 80$ ksi) is being used to assist with congestion of reinforcement at columns/beams joints.

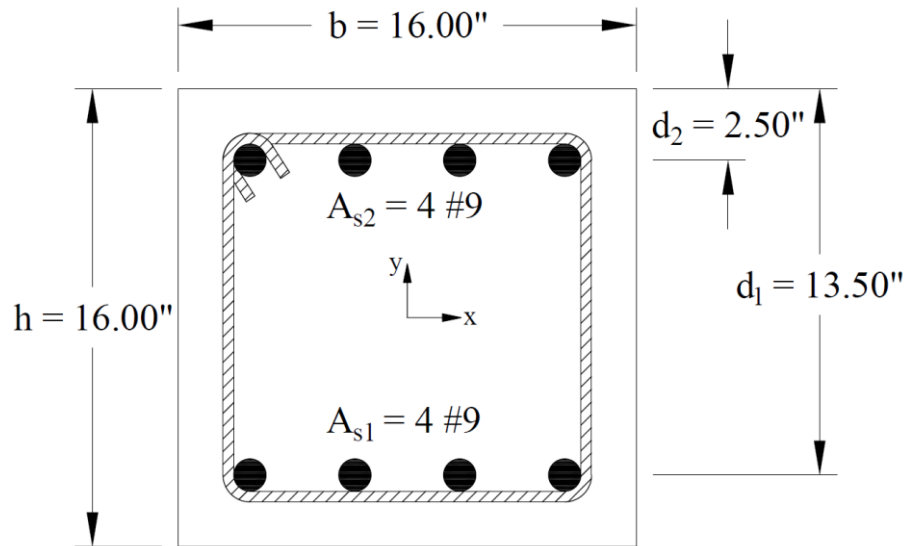


Figure 1 – Reinforced Concrete Column Cross-Section

Contents

1. Pure Compression	5
1.1. Nominal axial compressive strength at zero eccentricity	5
1.2. Factored axial compressive strength at zero eccentricity	5
1.3. Maximum (allowable) factored axial compressive strength.....	5
2. Bar Stress Near Tension Face of Member Equal to Zero, ($\varepsilon_s = f_s = 0$).....	6
2.1. c , a , and strains in the reinforcement	6
2.2. Forces in the concrete and steel.....	6
2.3. ϕP_n and ϕM_n	7
3. Bar Stress Near Tension Face of Member Equal to $0.5 f_y$, ($f_s = - 0.5 f_y$).....	8
3.1. c , a , and strains in the reinforcement	8
3.2. Forces in the concrete and steel.....	8
3.3. ϕP_n and ϕM_n	9
4. Bar Stress Near Tension Face of Member Equal to f_y , ($f_s = - f_y$).....	10
4.1. c , a , and strains in the reinforcement	10
4.2. Forces in the concrete and steel.....	11
4.3. ϕP_n and ϕM_n	11
5. Bar Strain Near Tension Face of Member Equal to $\varepsilon_y + 0.003$, ($\varepsilon_s = - 0.00576 \text{ in./in.}$).....	12
5.1. c , a , and strains in the reinforcement	12
5.2. Forces in the concrete and steel.....	13
5.3. ϕP_n and ϕM_n	13
6. Pure Bending.....	14
6.1. c , a , and strains in the reinforcement	14
6.2. Forces in the concrete and steel.....	15
6.3. ϕP_n and ϕM_n	15
7. Pure Tension.....	16
7.1. P_{nt} and ϕP_{nt}	16
7.2. M_n and ϕM_n	16
8. Column Interaction Diagram - spColumn Software.....	17
9. Summary and Comparison of Design Results.....	26
10. Conclusions & Observations.....	27

Code

Building Code Requirements for Structural Concrete (ACI 318-19) and Commentary (ACI 318R-19)

References

Reinforced Concrete Mechanics and Design, 6th Edition, 2011, James Wight and James MacGregor, Pearson

[Column Design with High-Strength Reinforcing Bars per ACI 318-19](#), 2019, StructurePoint

[Column Design Capacity Comparison with High Strength Reinforcing Bars per ACI 318-14 and ACI 318-19](#), 2019, StructurePoint

[ACI 318-19 Code Revisions Impact on StructurePoint Software](#), 2019, StructurePoint

Design Data

$$f_c' = 5000 \text{ psi}$$

$$f_y = 80,000 \text{ psi}$$

Cover = 2.5 in. to the center of the reinforcement

Column 16 in. x 16 in.

Top reinforcement = 4 #9

Bottom reinforcement = 4 #9

Solution

Use the traditional hand calculations approach to generate the interaction diagram for the concrete column section shown above by determining the following seven control points:

Point 1: Pure compression

Point 2: Bar stress near tension face of member equal to zero, ($f_s = 0$)

Point 3: Bar stress near tension face of member equal to $0.5 f_y$ ($f_s = - 0.5 f_y$)

Point 4: Bar stress near tension face of member equal to f_y ($f_s = - f_y$)

Point 5: Bar strain near tension face of member equal to $\epsilon_y + \mathbf{0.003}$

Point 6: Pure bending

Point 7: Pure tension

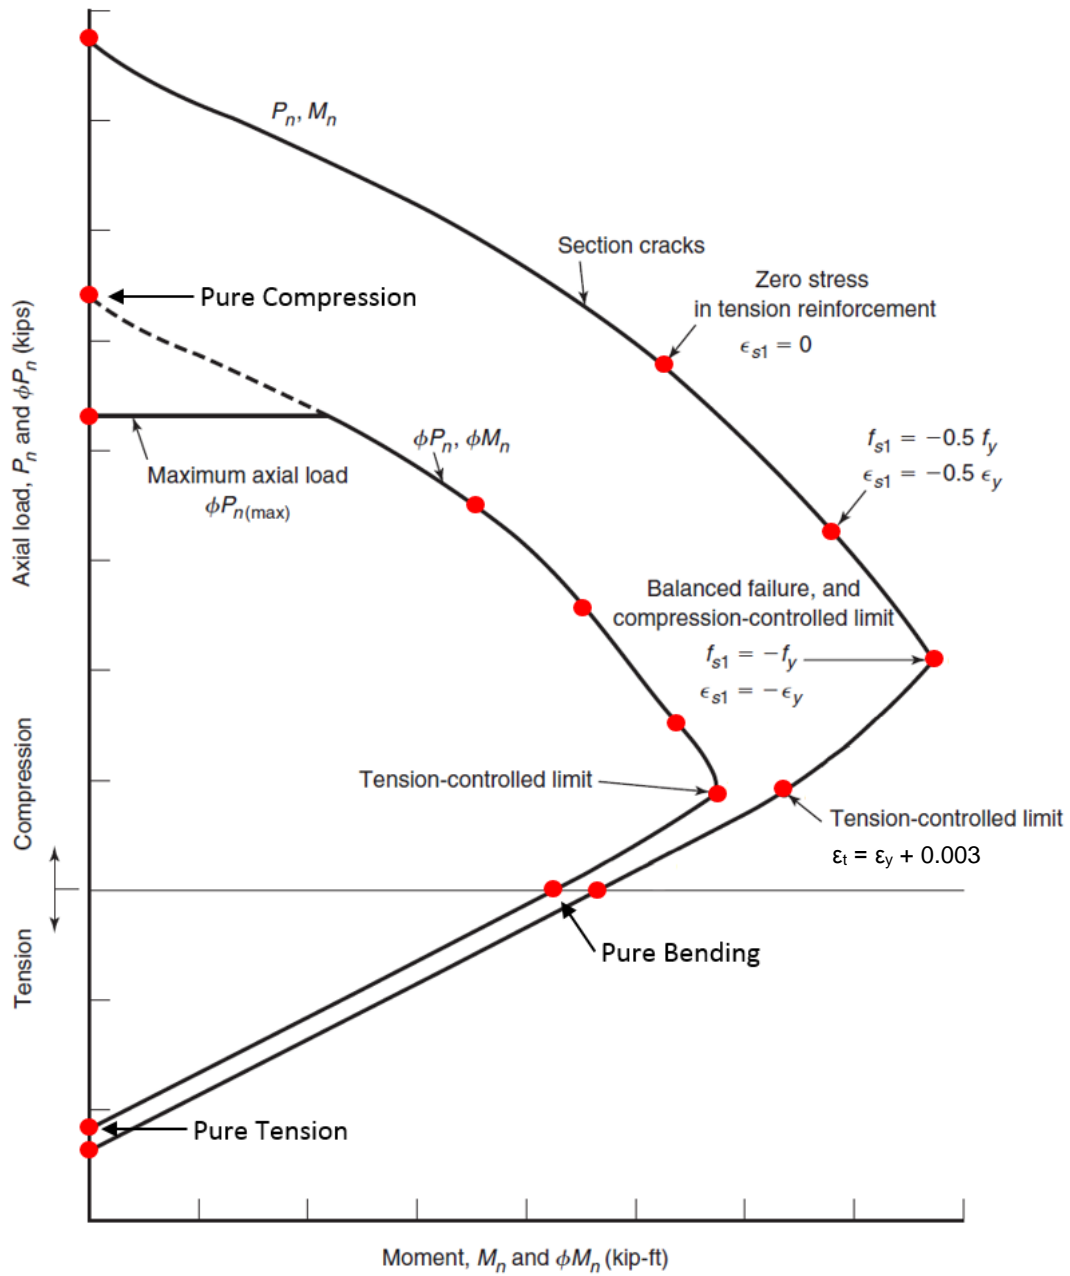


Figure 2 – Control Points

1. Pure Compression

1.1. Nominal axial compressive strength at zero eccentricity

$$P_o = 0.85f'_c(A_g - A_{st}) + f_y A_{st} \quad \text{ACI 318-19 (22.4.2.2)}$$

$$P_o = 0.85 \times 5000 \times (16 \times 16 - 8 \times 1.00) + 80000 \times 8 \times 1.00 = 1694 \text{ kips}$$

1.2. Factored axial compressive strength at zero eccentricity

Since this column is a tied column with steel strain in compression:

$$\phi = 0.65 \quad \text{ACI 318-19 (Table 21.2.2)}$$

$$\phi P_o = 0.65 \times 1694 = 1101.1 \text{ kips}$$

1.3. Maximum (allowable) factored axial compressive strength

$$\phi P_{n,max} = 0.80 \times \phi P_o = 0.80 \times 1101.1 = 880.9 \text{ kips} \quad \text{ACI 318-19 (Table 22.4.2.1)}$$

2. Bar Stress Near Tension Face of Member Equal to Zero, ($\epsilon_s = f_s = 0$)

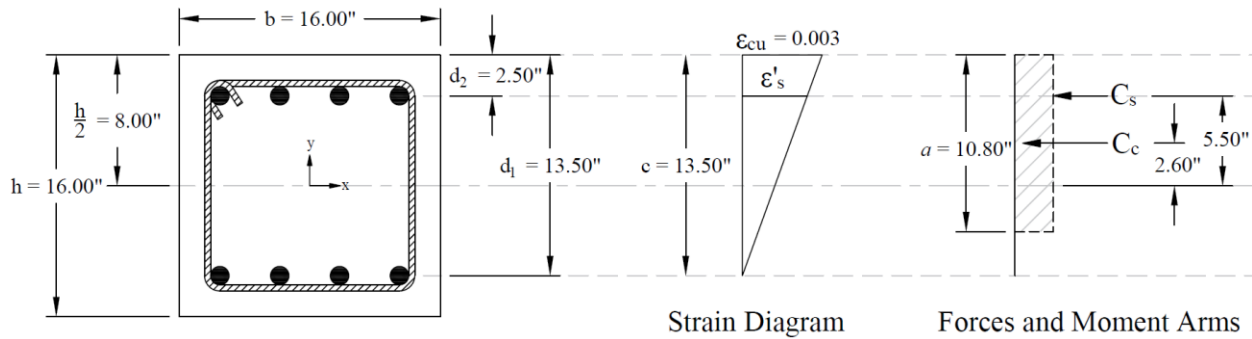


Figure 3 – Strains, Forces, and Moment Arms ($\epsilon_t = f_s = 0$)

Strain ϵ_s is zero in the extreme layer of tension steel. This case is considered when calculating an interaction diagram because it marks the change from compression lap splices being allowed on all longitudinal bars, to the more severe requirement of tensile lap splices. ACI 318-19 (10.7.5.2.1 and 2)

2.1. c, a, and strains in the reinforcement

$$c = d_1 = 13.5 \text{ in.}$$

Where c is the distance from the fiber of maximum compressive strain to the neutral axis.

ACI 318-19 (22.2.2.4.2)

$$a = \beta_1 \times c = 0.80 \times 13.5 = 10.80 \text{ in.}$$

ACI 318-19 (22.2.2.4.1)

Where:

a = Depth of equivalent rectangular stress block

$$\beta_1 = 0.85 - \frac{0.05 \times (f'_c \times 4000)}{1000} = 0.85 - \frac{0.05 \times (5000 - 4000)}{1000} = 0.80$$

ACI 318-19 (Table 22.2.2.4.3)

$$\epsilon_s = 0$$

$$\therefore \phi = 0.65$$

ACI 318-19 (Table 21.2.2)

$$\epsilon_{cu} = 0.003$$

ACI 318-19 (22.2.2.1)

$$\epsilon'_s = (c - d_2) \times \frac{\epsilon_{cu}}{c} = (13.50 - 2.5) \times \frac{0.003}{13.50} = 0.00244 \text{ (Compression)} < \epsilon_y = \frac{F_y}{E_s} = \frac{80}{29000} = 0.00276$$

2.2. Forces in the concrete and steel

$$C_c = 0.85 \times f'_c \times a \times b = 0.85 \times 5,000 \times 10.80 \times 16 = 734.4 \text{ kip}$$

ACI 318-19 (22.2.2.4.1)

$$f_s = 0 \text{ psi} \rightarrow T_s = f_s \times A_{s1} = 0 \text{ kip}$$

Since $\varepsilon'_s < \varepsilon_y \rightarrow$ compression reinforcement has not yielded

$$\therefore f'_s = \varepsilon'_s \times E_s = 0.00244 \times 29000000 = 70889 \text{ psi}$$

The area of the reinforcement in this layer has been included in the area (ab) used to compute C_c . As a result, it is necessary to subtract $0.85f'_c$ from f'_s before computing C_s :

$$C_s = (f'_s - 0.85f'_c) \times A_{s2} = (80000 - 0.85 \times 5000) \times 4 = 266.6 \text{ kip}$$

2.3. ϕP_n and ϕM_n

$$P_n = C_c + C_s - T_s = 734.4 + 266.6 - 0 = 1001.0 \text{ kip}$$

$$\phi P_n = 0.65 \times 1001.0 = 650.6 \text{ kip}$$

$$M_n = C_c \times \left(\frac{h}{2} - \frac{a}{2} \right) + C_s \times \left(\frac{h}{2} - d_2 \right) + T_s \times \left(d_1 - \frac{h}{2} \right)$$

$$M_n = 734.4 \times \left(\frac{16}{2} - \frac{10.80}{2} \right) + 266.6 \times \left(\frac{16}{2} - 2.5 \right) + 0 \times \left(13.50 - \frac{16}{2} \right) = 281.3 \text{ kip.ft}$$

$$\phi M_n = 0.65 \times 281.3 = 182.8 \text{ kip.ft}$$

3. Bar Stress Near Tension Face of Member Equal to $0.5 f_y$, ($f_s = -0.5 f_y$)

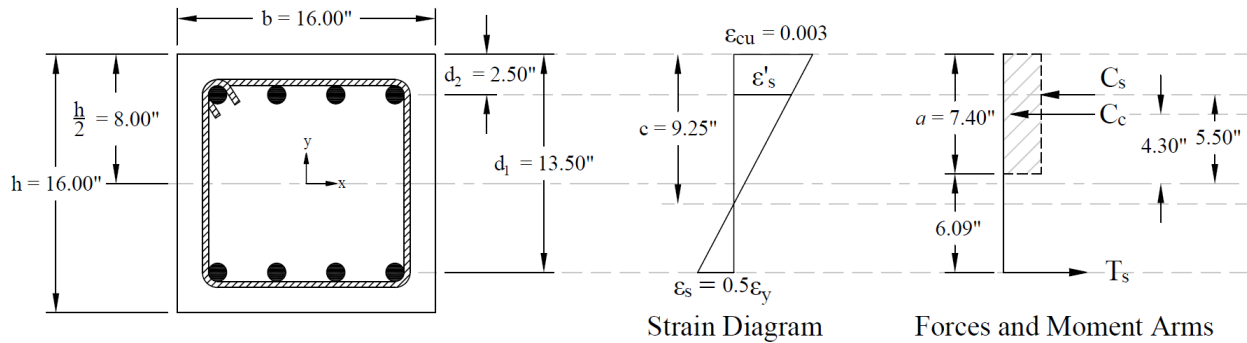


Figure 4 – Strains, Forces, and Moment Arms ($f_s = -0.5 f_y$)

3.1. c, a, and strains in the reinforcement

$$\varepsilon_y = \frac{f_y}{E_s} = \frac{80}{29000} = 0.00276$$

$$\varepsilon_s = \frac{\varepsilon_y}{2} = \frac{0.00276}{2} = 0.00138 < \varepsilon_y \rightarrow \text{tension reinforcement has not yielded}$$

$$\therefore \phi = 0.65$$

ACI 318-19 (Table 21.2.2)

$$\varepsilon_{cu} = 0.003$$

ACI 318-19 (22.2.2.1)

$$c = \frac{d_1}{\varepsilon_s + \varepsilon_{cu}} \times \varepsilon_{cu} = \frac{13.50}{0.00138 + 0.003} \times 0.003 = 9.25 \text{ in.}$$

Where c is the distance from the fiber of maximum compressive strain to the neutral axis.

ACI 318-19 (22.2.2.4.2)

$$a = \beta_1 \times c = 0.80 \times 9.25 = 7.40 \text{ in.}$$

ACI 318-19 (22.2.2.4.1)

Where:

$$\beta_1 = 0.85 - \frac{0.05 \times (f'_c \times 4000)}{1000} = 0.85 - \frac{0.05 \times (5000 - 4000)}{1000} = 0.80$$

ACI 318-19 (Table 22.2.2.4.3)

$$\varepsilon'_s = (c - d_2) \times \frac{0.003}{c} = (9.25 - 2.5) \times \frac{0.003}{9.25} = 0.00219 \text{ (Compression)} < \varepsilon_y$$

3.2. Forces in the concrete and steel

$$C_c = 0.85 \times f'_c \times a \times b = 0.85 \times 5000 \times 7.40 \times 16 = 503.1 \text{ kip}$$

ACI 318-19 (22.2.2.4.1)

$$f_s = \varepsilon_s \times E_s = 0.00138 \times 29000000 = 40000 \text{ psi}$$

$$T_s = f_s \times A_{s1} = 40000 \times 4 = 160 \text{ kip}$$

Since $\varepsilon_s' < \varepsilon_y$ \rightarrow compression reinforcement has not yielded

$$\therefore f_s' = \varepsilon_s' \times E_s = 0.00219 \times 29000000 = 63481 \text{ psi}$$

The area of the reinforcement in this layer has been included in the area (ab) used to compute C_c . As a result, it is necessary to subtract $0.85f_c'$ from f_s' before computing C_s :

$$C_s = (f_s' - 0.85f_c') \times A_{s2} = (63481 - 0.85 \times 5000) \times 4 = 237.0 \text{ kip}$$

3.3. ϕP_n and ϕM_n

$$P_n = C_c + C_s - T_s = 503.1 + 237.0 - 160.0 = 580.0 \text{ kip}$$

$$\phi P_n = 0.65 \times 580.0 = 377.0 \text{ kip}$$

$$M_n = C_c \times \left(\frac{h}{2} - \frac{a}{2} \right) + C_s \times \left(\frac{h}{2} - d_2 \right) + T_s \times \left(d_1 - \frac{h}{2} \right)$$

$$M_n = 503.1 \times \left(\frac{16}{2} - \frac{7.40}{2} \right) + 237.0 \times \left(\frac{16}{2} - 2.5 \right) + 160.0 \times \left(13.50 - \frac{16}{2} \right) = 362.2 \text{ kip.ft}$$

$$\phi M_n = 0.65 \times 362.2 = 235.5 \text{ kip.ft}$$

4. Bar Stress Near Tension Face of Member Equal to f_y , ($f_s = -f_y$)

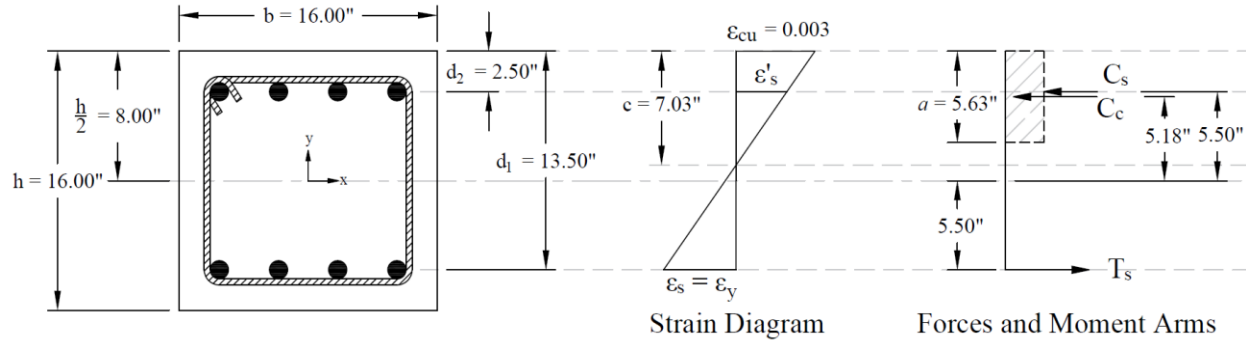


Figure 5 – Strains, Forces, and Moment Arms ($f_s = -f_y$)

This strain distribution is called the balanced failure case and the compression-controlled strain limit. It marks the change from compression failures originating by crushing of the compression surface of the section, to tension failures initiated by yield of longitudinal reinforcement. It also marks the start of the transition zone for ϕ for columns in which ϕ increases from 0.65 (or 0.75 for spiral columns) up to 0.90.

4.1. c, a, and strains in the reinforcement

$$\varepsilon_y = \frac{f_y}{E_s} = \frac{80}{29000} = 0.00276$$

$$\varepsilon_s = \varepsilon_y = 0.00276 \rightarrow \text{tension reinforcement has yielded}$$

$$\therefore \phi = 0.65$$

ACI 318-19 (Table 21.2.2)

$$\varepsilon_{cu} = 0.003$$

ACI 318-19 (22.2.2.1)

$$c = \frac{d_1}{\varepsilon_s + \varepsilon_{cu}} \times \varepsilon_{cu} = \frac{13.50}{0.00276 + 0.003} \times 0.003 = 7.03 \text{ in.}$$

Where c is the distance from the fiber of maximum compressive strain to the neutral axis.

ACI 318-19 (22.2.2.4.2)

$$a = \beta_1 \times c = 0.80 \times 7.03 = 5.63 \text{ in.}$$

ACI 318-19 (22.2.2.4.1)

Where:

$$\beta_1 = 0.85 - \frac{0.05 \times (f'_c \times 4000)}{1000} = 0.85 - \frac{0.05 \times (5000 \times 4000)}{1000} = 0.80$$

ACI 318-19 (Table 22.2.2.4.3)

$$\varepsilon'_s = (c - d_2) \times \frac{0.003}{c} = (7.03 - 2.5) \times \frac{0.003}{7.03} = 0.00193 \text{ (Compression)} < \varepsilon_y$$

4.2. Forces in the concrete and steel

$$C_c = 0.85 \times f'_c \times a \times b = 0.85 \times 5000 \times 5.63 \times 16 = 382.6 \text{ kip}$$

ACI 318-19 (22.2.2.4.1)

$$f_s = f_y = 80000 \text{ psi}$$

$$T_s = f_y \times A_{s1} = 80000 \times 4 = 320 \text{ kip}$$

Since $\epsilon'_s < \epsilon_y \rightarrow$ compression reinforcement has not yielded

$$\therefore f'_s = \epsilon'_s \times E_s = 0.00193 \times 29000000 = 56074 \text{ psi}$$

The area of the reinforcement in this layer has been included in the area (ab) used to compute C_c . As a result, it is necessary to subtract $0.85f'_c$ from f'_s before computing C_s :

$$C_s = (f'_s - 0.85f'_c) \times A_{s2} = (56074 - 0.85 \times 5000) \times 4 = 207.3 \text{ kip}$$

4.3. ϕP_n and ϕM_n

$$P_n = C_c + C_s - T_s = 382.6 + 207.3 - 320.0 = 269.9 \text{ kip}$$

$$\phi P_n = 0.65 \times 269.9 = 175.4 \text{ kip}$$

$$M_n = C_c \times \left(\frac{h}{2} - \frac{a}{2} \right) + C_s \times \left(\frac{h}{2} - d_2 \right) + T_s \times \left(d_1 - \frac{h}{2} \right)$$

$$M_n = 382.6 \times \left(\frac{16}{2} - \frac{5.63}{2} \right) + 207.3 \times \left(\frac{16}{2} - 2.5 \right) + 320.0 \times \left(13.50 - \frac{16}{2} \right) = 407.0 \text{ kip.ft}$$

$$\phi M_n = 0.65 \times 407.0 = 264.6 \text{ kip.ft}$$

5. Bar Strain Near Tension Face of Member Equal to $\epsilon_y + 0.003$, ($\epsilon_s = - 0.00576$ in./in.)

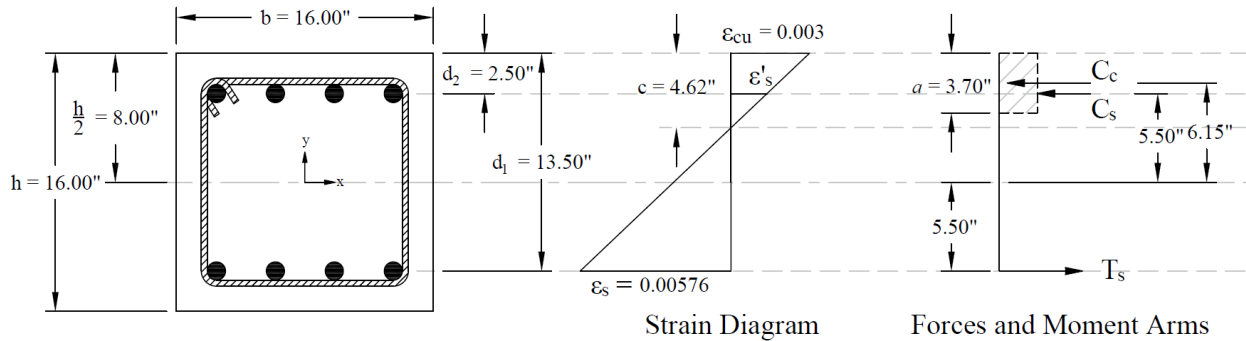


Figure 6 – Strains, Forces, and Moment Arms ($\epsilon_s = - 0.005$ in./in.)

This corresponds to the tension-controlled strain limit of $\epsilon_y + 0.003$ (this value used to be equal to 0.005 in older versions of ACI 318). It is the strain at the tensile limit of the transition zone for ϕ , used to define a tension-controlled section.

5.1. c, a, and strains in the reinforcement

$$\epsilon_y = \frac{f_y}{E_s} = \frac{80}{29000} = 0.00276$$

$$\epsilon_s = \epsilon_y + 0.003 = 0.00276 + 0.003 = 0.00576 > \epsilon_y \rightarrow \text{tension reinforcement has yielded}$$

$$\therefore \phi = 0.9$$

ACI 318-19 (Table 21.2.2)

$$\epsilon_{cu} = 0.003$$

ACI 318-19 (22.2.2.1)

$$c = \frac{d_1}{\epsilon_s + \epsilon_{cu}} \times \epsilon_{cu} = \frac{13.50}{0.00576 + 0.003} \times 0.003 = 4.62 \text{ in.}$$

Where c is the distance from the fiber of maximum compressive strain to the neutral axis.

ACI 318-19 (22.2.2.4.2)

$$a = \beta_1 \times c = 0.80 \times 4.62 = 3.70 \text{ in.}$$

ACI 318-19 (22.2.2.4.1)

Where:

$$\beta_1 = 0.85 - \frac{0.05 \times (f'_c \times 4000)}{1000} = 0.85 - \frac{0.05 \times (5000 - 4000)}{1000} = 0.80$$

ACI 318-19 (Table 22.2.2.4.3)

$$\epsilon'_s = (c - d_2) \times \frac{0.003}{c} = (4.62 - 2.5) \times \frac{0.003}{4.62} = 0.00138 \text{ (Compression)} < \epsilon_y$$

5.2. Forces in the concrete and steel

$$C_c = 0.85 \times f'_c \times a \times b = 0.85 \times 5000 \times 3.70 \times 16 = 251.5 \text{ kip}$$

ACI 318-19 (22.2.2.4.1)

$$f_s = f_y = 80000 \text{ psi}$$

$$T_s = f_y \times A_{s1} = 80000 \times 4 = 320 \text{ kip}$$

Since $\epsilon'_s < \epsilon_y \rightarrow$ compression reinforcement has not yielded

$$\therefore f'_s = \epsilon'_s \times E_s = 0.00138 \times 29000000 = 39963 \text{ psi}$$

The area of the reinforcement in this layer has been included in the area (ab) used to compute C_c . As a result, it is necessary to subtract $0.85f'_c$ from f'_s before computing C_s :

$$C_s = (f'_s - 0.85f'_c) \times A_{s2} = (39963 - 0.85 \times 5000) \times 4 = 142.9 \text{ kip}$$

5.3. ϕP_n and ϕM_n

$$P_n = C_c + C_s - T_s = 251.5 + 142.9 - 320 = 74.4 \text{ kip}$$

$$\phi P_n = 0.90 \times 74.4 = 67.0 \text{ kip}$$

$$M_n = C_c \times \left(\frac{h}{2} - \frac{a}{2} \right) + C_s \times \left(\frac{h}{2} - d_2 \right) + T_s \times \left(d_1 - \frac{h}{2} \right)$$

$$M_n = 251.5 \times \left(\frac{16}{2} - \frac{3.70}{2} \right) + 142.9 \times \left(\frac{16}{2} - 2.5 \right) + 320 \times \left(13.50 - \frac{16}{2} \right) = 341.1 \text{ kip.ft}$$

$$\phi M_n = 0.90 \times 341.1 = 307.0 \text{ kip.ft}$$

6. Pure Bending

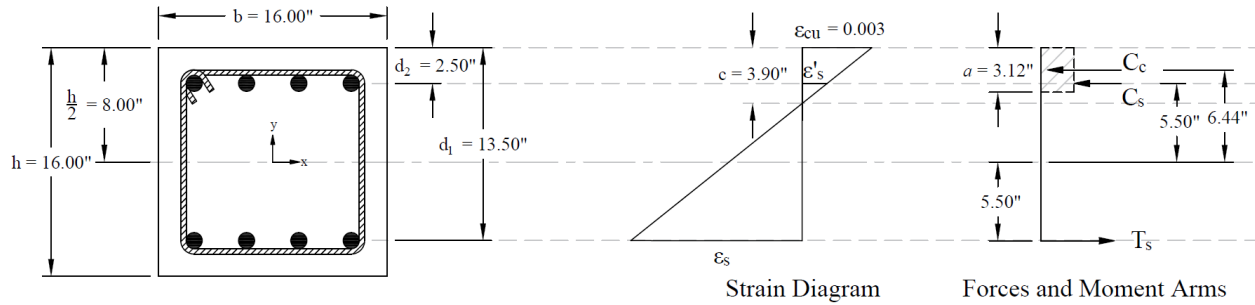


Figure 7 – Strains, Forces, and Moment Arms (Pure Moment)

This corresponds to the case where the nominal axial load capacity, P_n , is equal to zero. Iterative procedure is used to determine the nominal moment capacity as follows:

6.1. c , a , and strains in the reinforcement

Try $c = 3.899$ in.

Where c is the distance from the fiber of maximum compressive strain to the neutral axis.

ACI 318-19 (22.2.2.4.2)

$$a = \beta_1 \times c = 0.80 \times 3.899 = 3.119 \text{ in.}$$

ACI 318-19 (22.2.2.4.1)

Where:

$$\beta_1 = 0.85 - \frac{0.05 \times (f'_c \times 4000)}{1000} = 0.85 - \frac{0.05 \times (5000 \times 4000)}{1000} = 0.80$$

ACI 318-19 (Table 22.2.2.4.3)

$$\varepsilon_{cu} = 0.003$$

ACI 318-19 (22.2.2.1)

$$\varepsilon_y = \frac{f_y}{E_s} = \frac{80}{29000} = 0.00276$$

$$\varepsilon_s = (d_1 - c) \times \frac{0.003}{c}$$

$$\varepsilon_s = (13.50 - 3.899) \times \frac{0.003}{3.899} = 0.00739 \text{ (Tension)} > \varepsilon_y \rightarrow \text{tension reinforcement has yielded}$$

$$\therefore \phi = 0.9$$

ACI 318-19 (Table 21.2.2)

$$\varepsilon'_s = (c - d_2) \times \frac{0.003}{c}$$

$$\varepsilon'_s = (3.899 - 2.5) \times \frac{0.003}{3.899} = 0.00108 \text{ (Compression)} < \varepsilon_y \rightarrow \text{compression reinforcement has not yielded}$$

6.2. Forces in the concrete and steel

$$C_c = 0.85 \times f'_c \times a \times b = 0.85 \times 5000 \times 3.119 \times 16 = 212.1 \text{ kip}$$

ACI 318-19 (22.2.2.4.1)

$$f_s = f_y = 80000 \text{ psi}$$

$$T_s = f_y \times A_{s1} = 80000 \times 4 = 320 \text{ kip}$$

Since $\epsilon'_s < \epsilon_y \rightarrow$ compression reinforcement has not yielded

$$\therefore f'_s = \epsilon'_s \times E_s = 0.00108 \times 29000000 = 31216 \text{ psi}$$

The area of the reinforcement in this layer has been included in the area (ab) used to compute C_c . As a result, it is necessary to subtract $0.85f'_c$ from f'_s before computing C_s :

$$C_s = (f'_s - 0.85f'_c) \times A_{s2} = (31216 - 0.85 \times 5000) \times 4 = 107.9 \text{ kip}$$

6.3. ϕP_n and ϕM_n

$$P_n = C_c + C_s - T_s = 212.1 + 107.9 - 320 = 0 \text{ kip} \rightarrow \phi P_n = 0.0 \text{ kip}$$

The assumption that $c = 3.899$ in. is correct

$$M_n = C_c \times \left(\frac{h}{2} - \frac{a}{2} \right) + C_s \times \left(\frac{h}{2} - d_2 \right) + T_s \times \left(d_1 - \frac{h}{2} \right)$$

$$M_n = 212.1 \times \left(\frac{16}{2} - \frac{3.119}{2} \right) + 107.1 \times \left(\frac{16}{2} - 2.5 \right) + 320 \times \left(13.50 - \frac{16}{2} \right) = 309.9 \text{ kip.ft}$$

$$\phi M_n = 0.90 \times 209.9 = 278.9 \text{ kip.ft}$$

7. Pure Tension

The final loading case to be considered is concentric axial tension. The strength under pure axial tension is computed by assuming that the section is completely cracked through and subjected to a uniform strain greater than or equal to the yield strain in tension. The strength under such a loading is equal to the yield strength of the reinforcement in tension.

7.1. P_{nt} and ϕP_{nt}

$$P_{nt} = f_y \times (A_{s1} + A_{s2}) = 80000 \times (4 + 4) = 640.0 \text{ kip} \quad \text{ACI 318-19 (22.4.3.1)}$$

$$\phi = 0.9 \quad \text{ACI 318-19 (Table 21.2.2)}$$

$$\phi P_{nt} = 0.90 \times 640 = 576.0 \text{ kip}$$

7.2. M_n and ϕM_n

Since the section is symmetrical

$$M_n = \phi M_n = 0.0 \text{ kip.ft}$$

8. Column Interaction Diagram - spColumn Software

spColumn program performs the analysis of the reinforced concrete section conforming to the provisions of the Strength Design Method and Unified Design Provisions with all conditions of strength satisfying the applicable conditions of equilibrium and strain compatibility. For this column section, we ran in investigation mode with control points using the 318-19. In lieu of using program shortcuts, spSection (Figure 9) was used to place the reinforcement and define the cover to illustrate handling of irregular shapes and unusual bar arrangement.

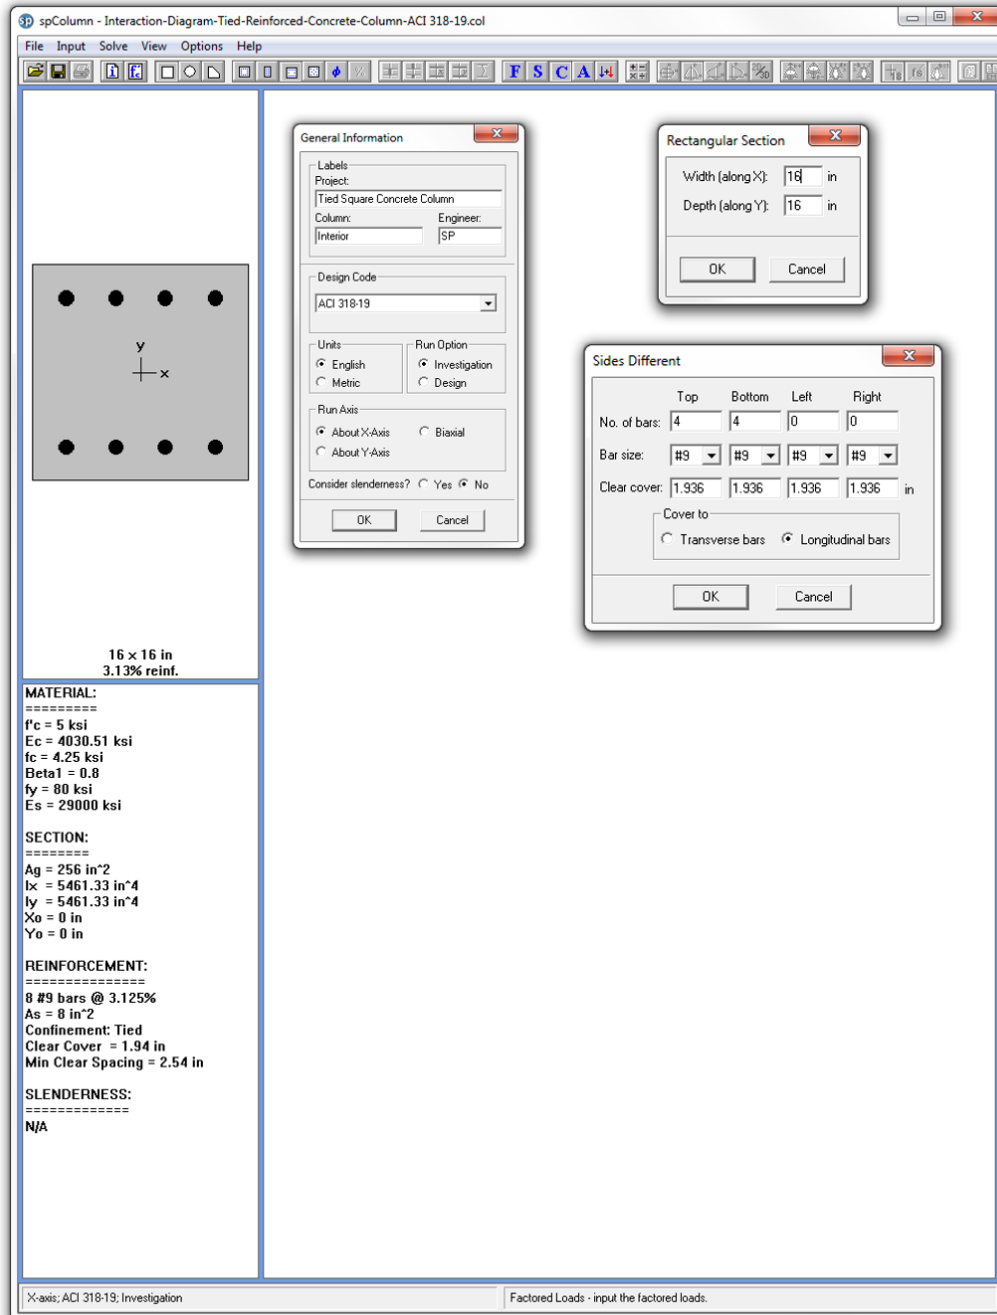


Figure 8 – Generating spColumn Model

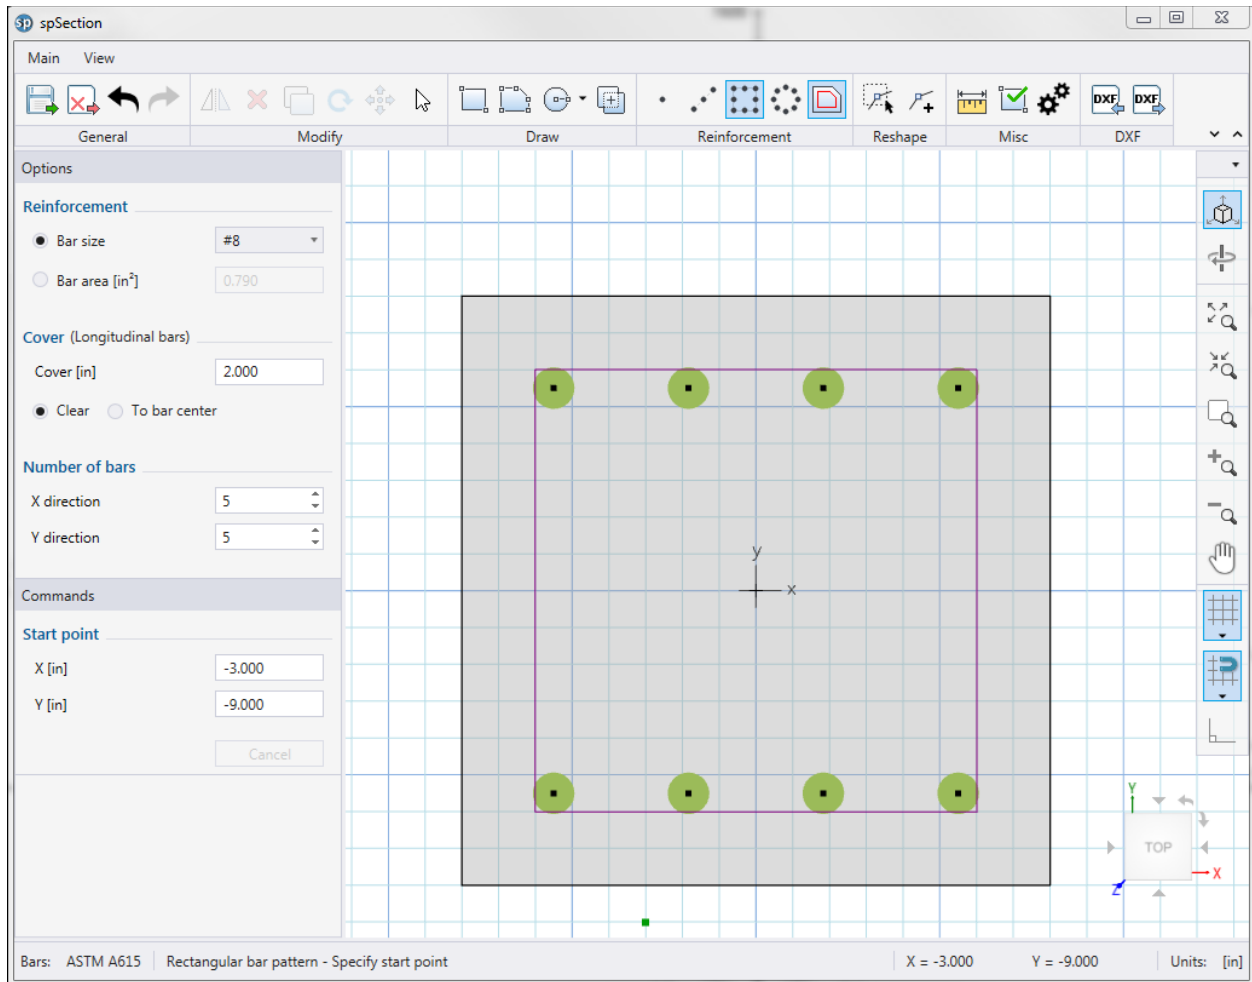


Figure 9 – spColumn Model Editor (spSection)


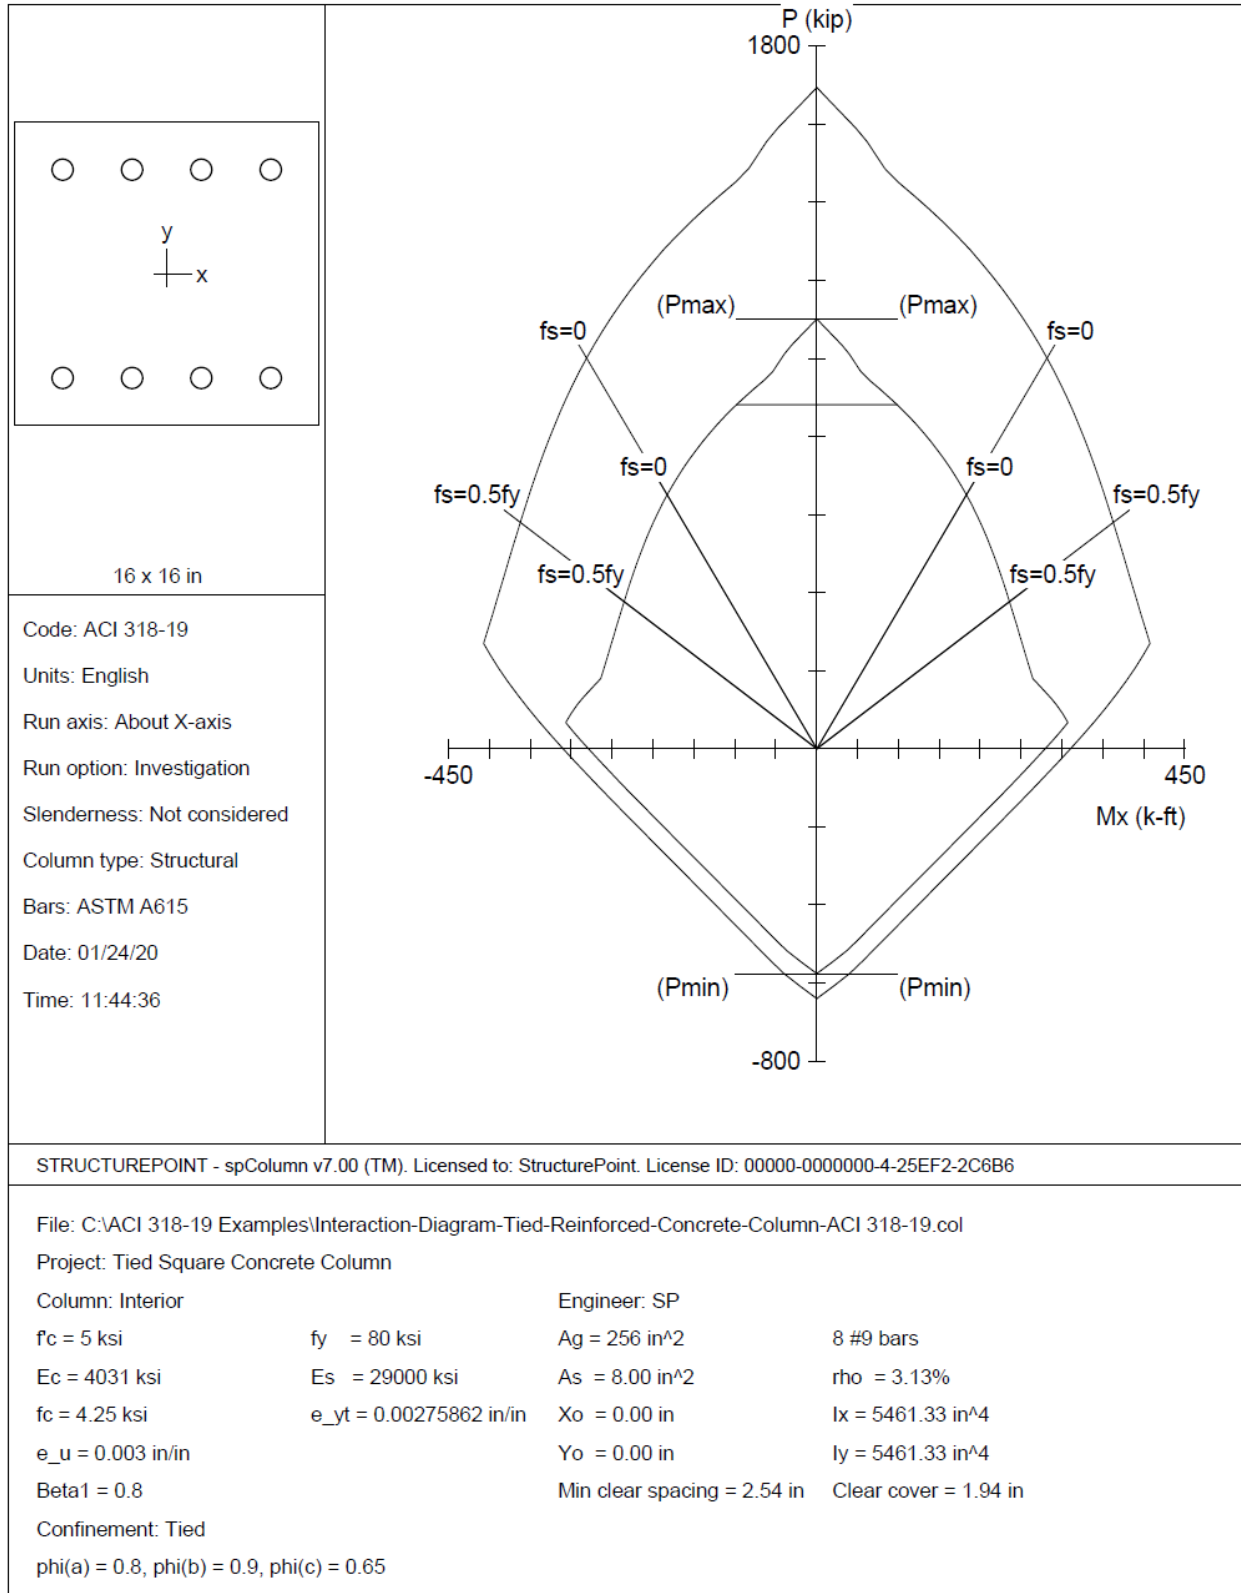


Figure 10 – Column Section Interaction Diagram about the X-Axis (spColumn)



spColumn v7.00
Computer program for the Strength Design of Reinforced Concrete Sections
Copyright - 1988-2020, STRUCTUREPOINT, LLC.
All rights reserved

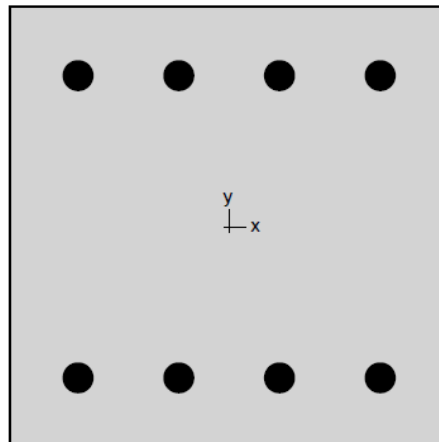

StructurePoint

Licensee stated below acknowledges that STRUCTUREPOINT (SP) is not and cannot be responsible for either the accuracy or adequacy of the material supplied as input for processing by the spColumn computer program. Furthermore, STRUCTUREPOINT neither makes any warranty expressed nor implied with respect to the correctness of the output prepared by the spColumn program. Although STRUCTUREPOINT has endeavored to produce spColumn error free the program is not and cannot be certified infallible. The final and only responsibility for analysis, design and engineering documents is the licensee's. Accordingly, STRUCTUREPOINT disclaims all responsibility in contract, negligence or other tort for any analysis, design or engineering documents prepared in connection with the use of the spColumn program. Licensed to: StructurePoint. License ID: 00000-0000000-4-25EF2-2C6B6

Contents

1. General Information.....	3
2. Material Properties.....	3
2.1. Concrete.....	3
2.2. Steel.....	3
3. Section.....	3
3.1. Shape and Properties.....	3
3.2. Section Figure.....	4
4. Reinforcement.....	4
4.1. Bar Set: ASTM A615.....	4
4.2. Confinement and Factors.....	4
4.3. Arrangement.....	4
4.4. Bars Provided.....	5
5. Control Points.....	5
6. Diagrams.....	6
6.1. PM at $\theta=0$ [deg].....	6

List of Figures

Figure 1: Column section.....	4
-------------------------------	---

1. General Information

File Name	...Interaction-Diagram-Tied-Reinforced-Concre...
Project	Tied Square Concrete Column
Column	Interior
Engineer	SP
Code	ACI 318-19
Bar Set	ASTM A615
Units	English
Run Option	Investigation
Run Axis	X - axis
Slenderness	Not Considered
Column Type	Structural
Capacity Method	Moment capacity

2. Material Properties

2.1. Concrete

Type	Standard
f'_c	5 ksi
E_c	4030.51 ksi
f_c	4.25 ksi
ϵ_u	0.003 in/in
β_1	0.8

2.2. Steel

Type	Standard
f_y	80 ksi
E_s	29000 ksi
ϵ_{yt}	0.00275862 in/in

3. Section

3.1. Shape and Properties

Type	Rectangular
Width	16 in
Depth	16 in
A_g	256 in ²
I_x	5461.33 in ⁴
I_y	5461.33 in ⁴
r_x	4.6188 in
r_y	4.6188 in
X_o	0 in
Y_o	0 in

3.2. Section Figure

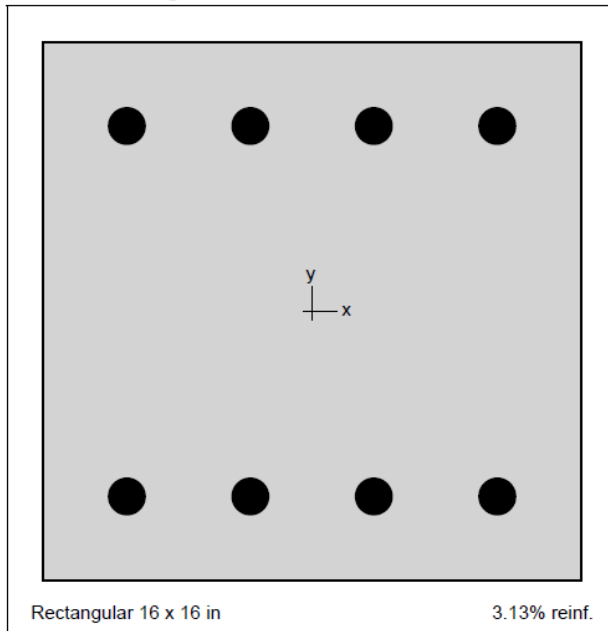


Figure 1: Column section

4. Reinforcement

4.1. Bar Set: ASTM A615

Bar	Diameter in	Area in ²	Bar	Diameter in	Area in ²	Bar	Diameter in	Area in ²
#3	0.38	0.11	#4	0.50	0.20	#5	0.63	0.31
#6	0.75	0.44	#7	0.88	0.60	#8	1.00	0.79
#9	1.13	1.00	#10	1.27	1.27	#11	1.41	1.56
#14	1.69	2.25	#18	2.26	4.00			

4.2. Confinement and Factors

Confinement type	Tied
For #10 bars or less	#3 ties
For larger bars	#4 ties
Capacity Reduction Factors	
Axial compression, (a)	0.8
Tension controlled ϕ , (b)	0.9
Compression controlled ϕ , (c)	0.65

4.3. Arrangement

Pattern	Sides different
Bar layout	Rectangular
Cover to	Longitudinal bars
Clear cover	---
Bars	---

Total steel area, A_s	8.00 in ²
Rho	3.13 %
Minimum clear spacing	2.54 in

4.4. Bars Provided


	Bars	Clear cover in
Top	4 #9	1.936
Bottom	4 #9	1.936
Left	0 #9	1.936
Right	0 #9	1.936

5. Control Points

About Point	P kip	X-Moment k-ft	Y-Moment k-ft	NA Depth in	d_t Depth in	ϵ_t	ϕ
X @ Max compression	1101.1	0.00	0.00	167.79	13.50	-0.00276	0.65000
X @ Allowable comp.	880.9	98.36	0.00	18.33	13.50	-0.00079	0.65000
X @ $f_s = 0.0$	650.6	182.84	0.00	13.50	13.50	0.00000	0.65000
X @ $f_s = 0.5 f_y$	377.0	235.45	0.00	9.25	13.50	0.00138	0.65000
X @ Balanced point	175.4	264.58	0.00	7.03	13.50	0.00276	0.65000
X @ Tension control	67.0	306.96	0.00	4.62	13.50	0.00576	0.90000
X @ Pure bending	0.0	278.96	0.00	3.90	13.50	0.00739	0.90000
X @ Max tension	-576.0	0.00	0.00	0.00	13.50	9.99999	0.90000
-X @ Max compression	1101.1	0.00	0.00	167.79	13.50	-0.00276	0.65000
-X @ Allowable comp.	880.9	-98.36	0.00	18.33	13.50	-0.00079	0.65000
-X @ $f_s = 0.0$	650.6	-182.84	0.00	13.50	13.50	0.00000	0.65000
-X @ $f_s = 0.5 f_y$	377.0	-235.45	0.00	9.25	13.50	0.00138	0.65000
-X @ Balanced point	175.4	-264.58	0.00	7.03	13.50	0.00276	0.65000
-X @ Tension control	67.0	-306.96	0.00	4.62	13.50	0.00576	0.90000
-X @ Pure bending	0.0	-278.96	0.00	3.90	13.50	0.00739	0.90000
-X @ Max tension	-576.0	0.00	0.00	0.00	13.50	9.99999	0.90000

6. Diagrams

6.1. PM at $\theta=0$ [deg]

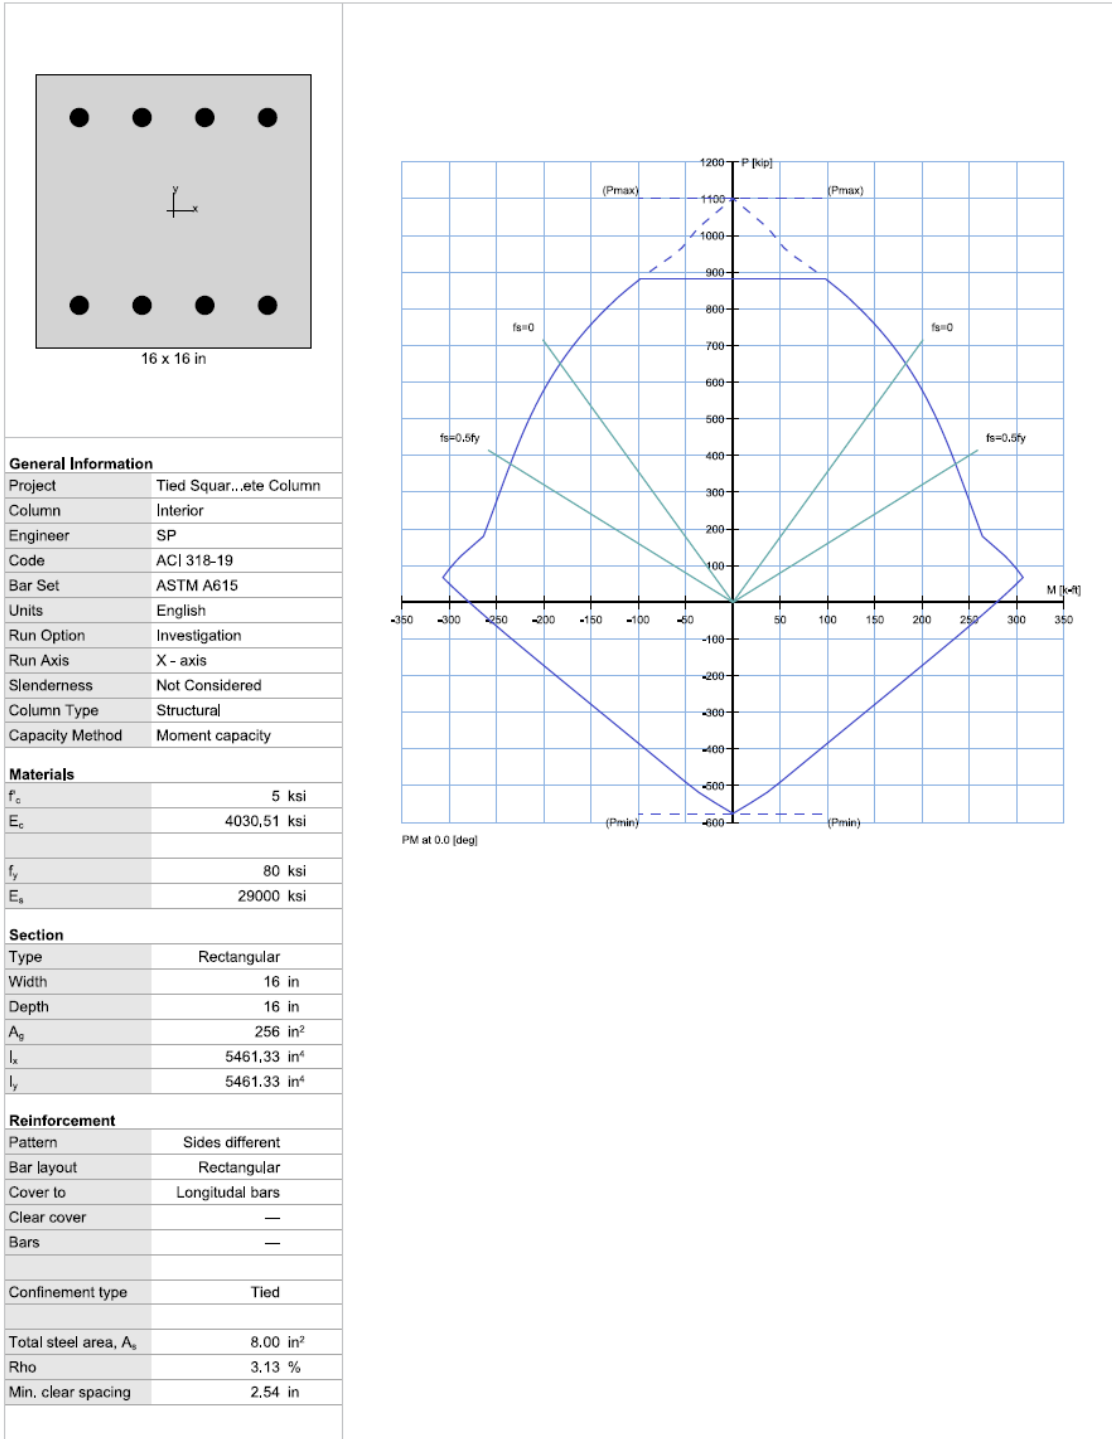

9. Summary and Comparison of Design Results

Table 1 - Comparison of Results				
Support	ϕP_n, kip		ϕM_n, kip.ft	
	Hand	spColumn	Hand	spColumn
Max compression	1101.1	1101.1	0.0	0.0
Allowable compression	880.9	880.9	---	---
$f_s = 0.0$	650.6	650.6	182.8	182.8
$f_s = 0.5 f_y$	377.0	377.0	235.5	235.5
Balanced point	175.4	175.4	264.6	264.6
Tension control	67.0	67.0	307.0	307.0
Pure bending	0.0	0.0	278.9	279.0
Max tension	576.0	576.0	0.0	0.0

In all of the hand calculations illustrated above for this column with HSRB, the results are in precise agreement with the automated exact results obtained from the [spColumn](#) program.

10. Conclusions & Observations

The analysis of the reinforced concrete section performed by [spColumn](#) conforms to the provisions of the Strength Design Method and Unified Design Provisions with all conditions of strength satisfying the applicable conditions of equilibrium and strain compatibility.

ACI 318-19 introduced new provisions for high-strength reinforcing bars (HSRB) with 80 ksi and 100 ksi strengths. Table 21.2.2 in ACI 318-19 defines the strength reduction factor ϕ , for tension-controlled sections as an expression of f_y , for all reinforcement grades. Previously in ACI 318-14 Fig. R21.2.2b, the tension-controlled strain limit was set to 0.005. Therefore, beginning with the 2019 Code, the expression $(\epsilon_{ty} + 0.003)$ defines the lower limit on ϵ_t for tension-controlled behavior. The new limit leads to a constant transition zone range from ϵ_{ty} to $\epsilon_{ty} + 0.003$.

The Figure below shows factored P-M interaction diagrams for a column section with Gr 80 reinforcement per ACI 318-14 where the tension-controlled limit was 0.005 and per ACI 318-19 where the tension-controlled limit for Gr 80 is 0.00576 ($\epsilon_{ty} + 0.003$). The change in the tension-controlled limit leads to the reduction of axial load and moment capacities in the transition zone for this column section designed in accordance with ACI 318-19.

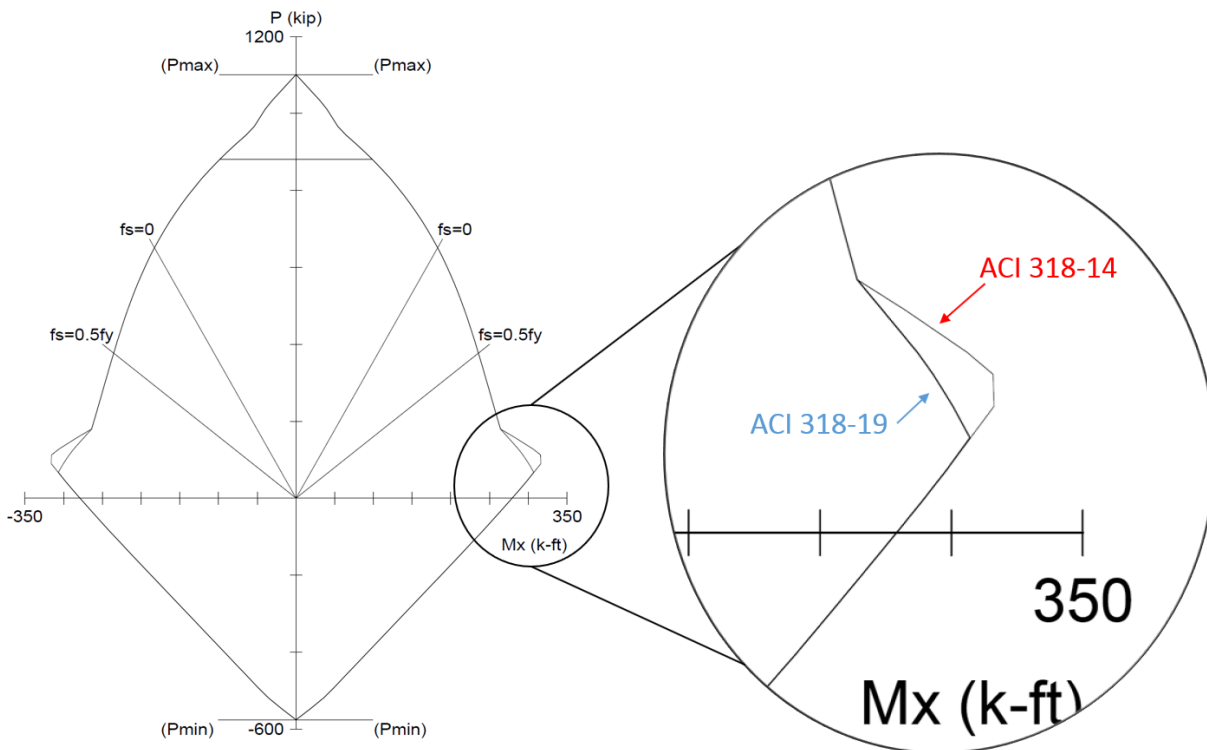


Figure 11 – Design (Factored) Interaction Diagrams using ACI 318-14 and ACI 318-19 ([spColumn](#))

The Figure below shows factored interaction diagrams for a column section with Gr 60 and Gr 80 reinforcement per ACI 318-19. The factored moment capacity of a column with Gr 80 reinforcement is greater than that of a column with Gr 60 reinforcement with the exception of the transition zone region of a column with Gr 60 reinforcement.

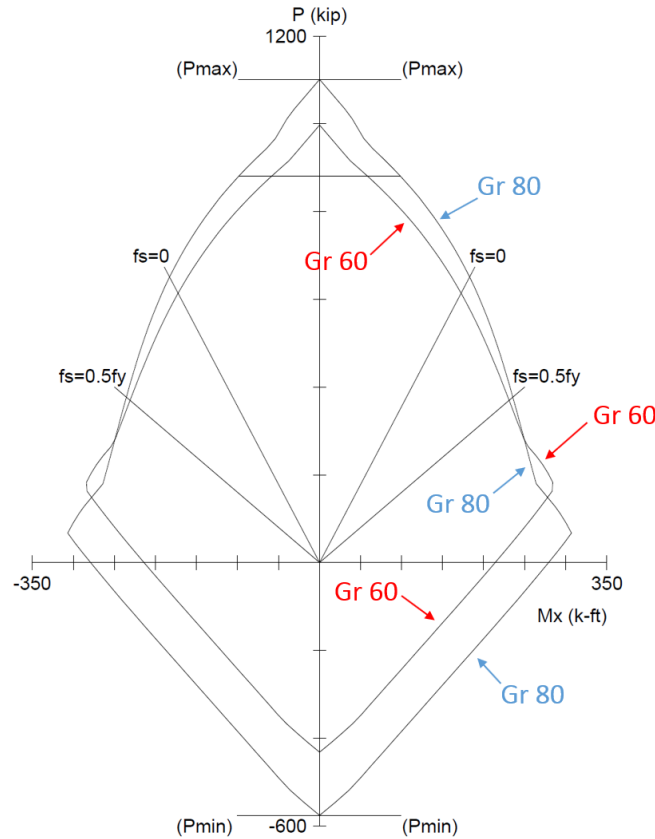


Figure 12 – Design (Factored) Interaction Diagrams using Gr 60 and Gr 80 (spColumn)

In the calculation shown above a P-M interaction diagram was generated with moments about the X-Axis (Uniaxial bending). Since the reinforcement in the section is not symmetrical, a different P-M interaction diagram is needed for the other orthogonal direction about the Y-Axis (See the following Figure for the case where $f_s = f_y$).


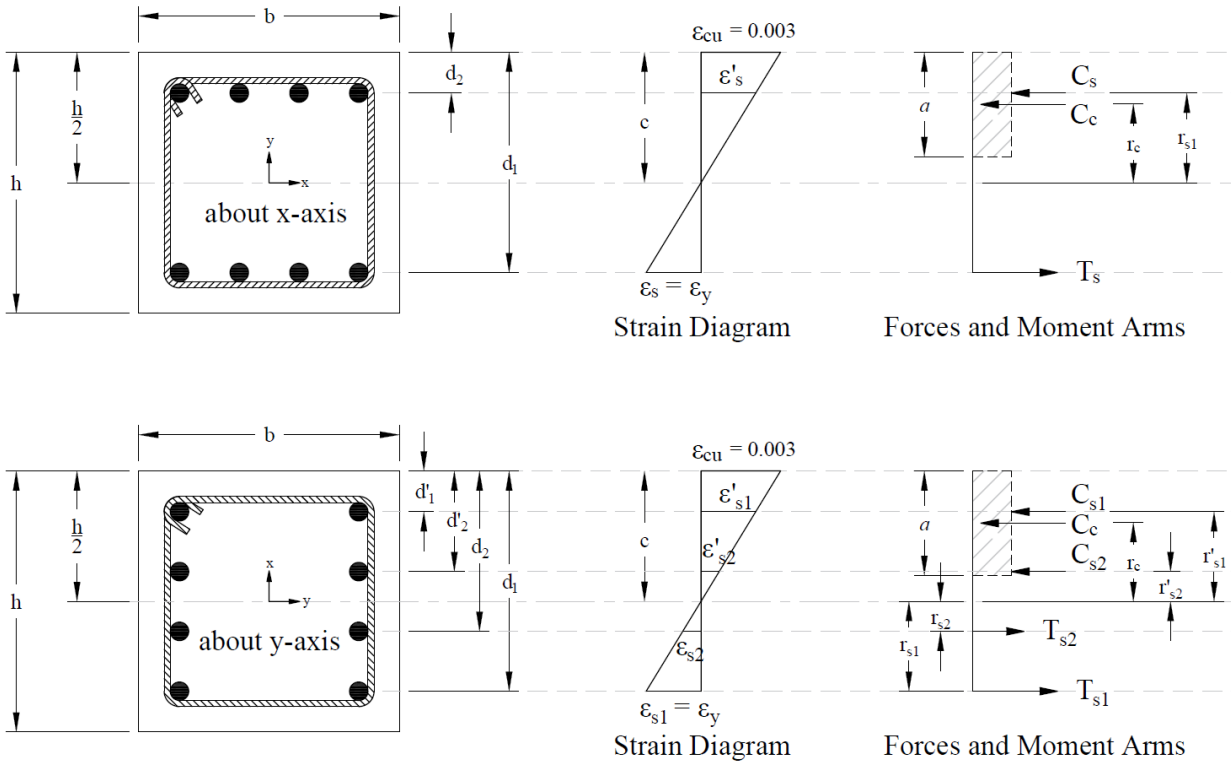


Figure 13 – Strains, Forces, and Moment Arms ($f_s = -f_y$ Moments About x- and y-axis)

When running about the Y-Axis, we have 2 bars in 4 layers instead of 4 bars in just 2 layers (about X-Axis) resulting in a completely different interaction diagram as shown in the following Figure.

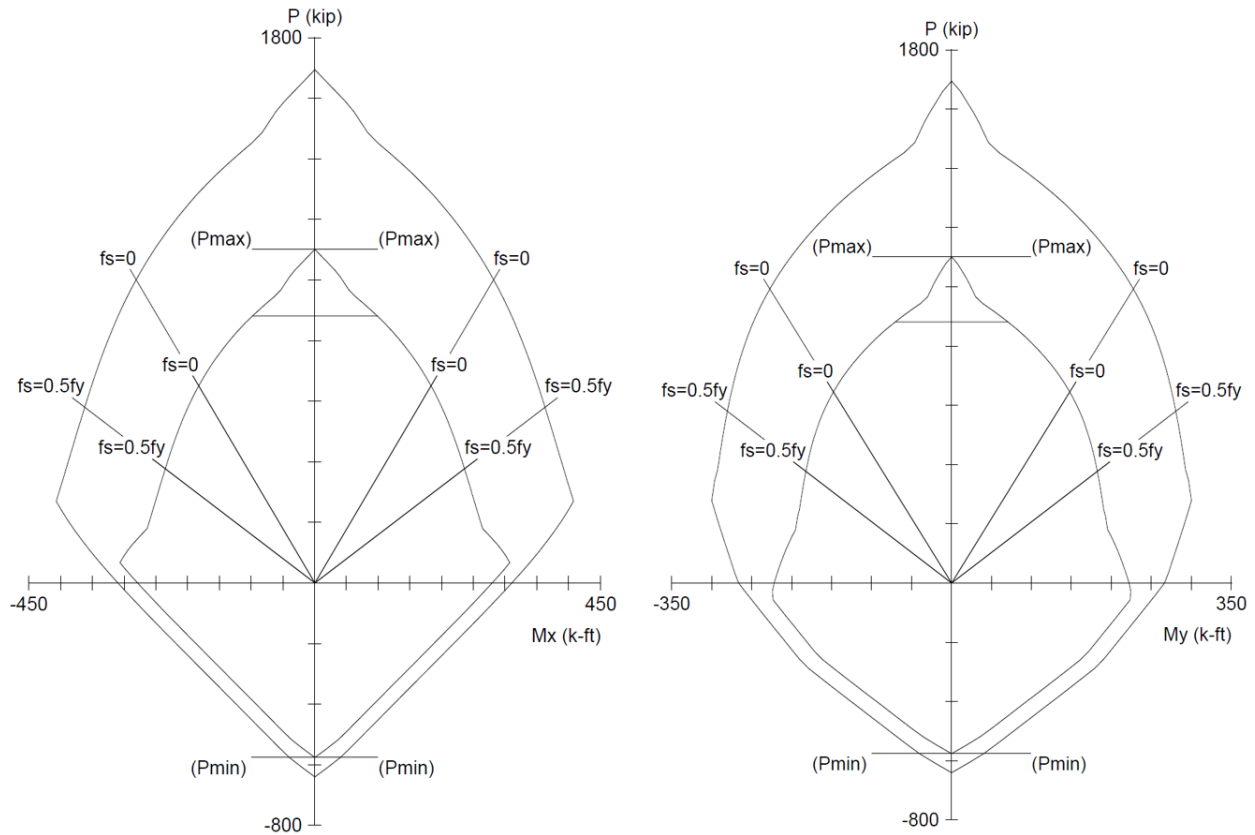

Interaction Diagram About the X-Axis

Interaction Diagram About the Y-Axis

Figure 14 – Comparison of Column Interaction Diagrams about X-Axis and Y-Axis ([spColumn](#))

Further differences in the interaction diagram in both directions can result if the column cross section geometry is irregular.

In most building design calculations, such as the examples shown for [flat plate](#) or [flat slab](#) concrete floor systems, all building columns are subjected to M_x and M_y due to lateral forces and unbalanced moments from both directions of analysis. This requires an evaluation of the column P-M interaction diagram in two directions simultaneously (biaxial bending).

StructurePoint's [spColumn](#) program can also evaluate column sections in biaxial mode to produce the results shown in the following Figure for the column section in this example.

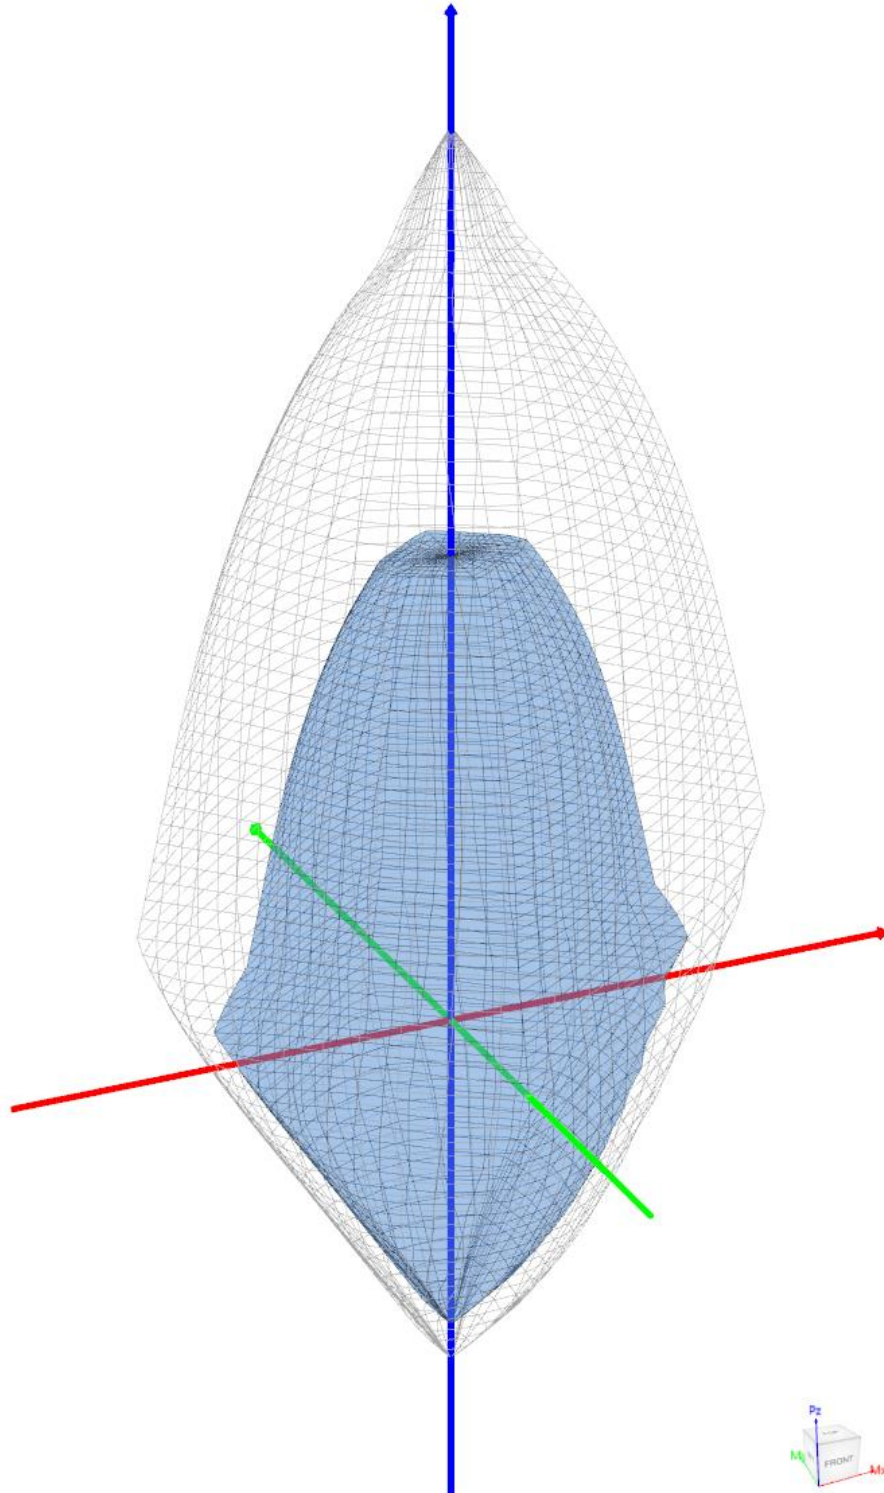


Figure 15 – Nominal & Design Interaction Diagram in Two Directions (Biaxial) (spColumn)